
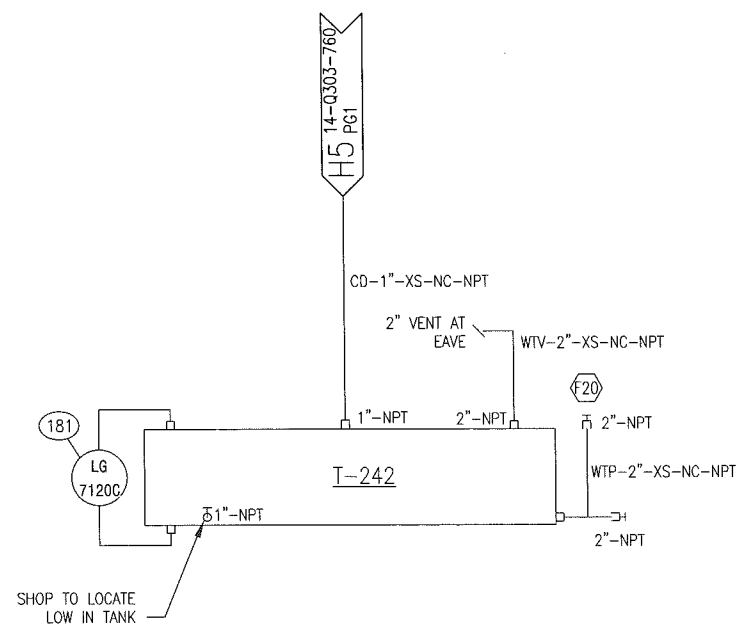
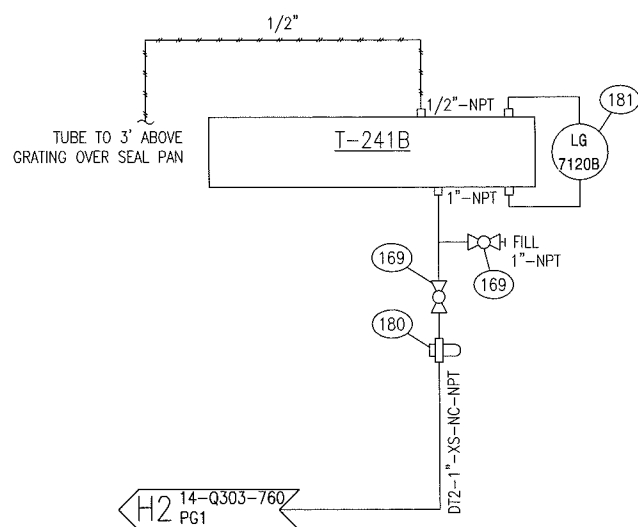


T-241A
INTEGRAL CRANE DAY TANK
VOLUME: 100 GALLONS
SERVICE: COMPRESSOR CRANKCASE OIL
FILL: SAE 40WT LUBE OIL

T-241B
INTEGRAL CRANE DAY TANK
VOLUME: 100 GALLONS
SERVICE: COMPRESSOR CYLINDER OIL
FILL: SAE 40WT LUBE OIL

T-242
INTEGRAL SKID TANK
VOLUME: 100 GALLONS
SERVICE: WASTE OIL
FILL: N/A

BILL OF MATERIALS			
MK	QTY	PART NUMBER	DESCRIPTION
169	4	BVSF-102CS	VALVE, BALL, 1"-FNPT, 2000#, FP, 2PC, SWT MFG: FUSION MODEL: 428TF010F20N1AN
180	2	TNK-310	FILTER, 1"-NPT, 9 MICRON MFG: BALDWIN MODEL: BF914
181	3	TNK-217	GAUGE, LEVEL, TANK, ALUMIMUM MFG: NORCAN FLUID POWER MODEL: YB4353-0900

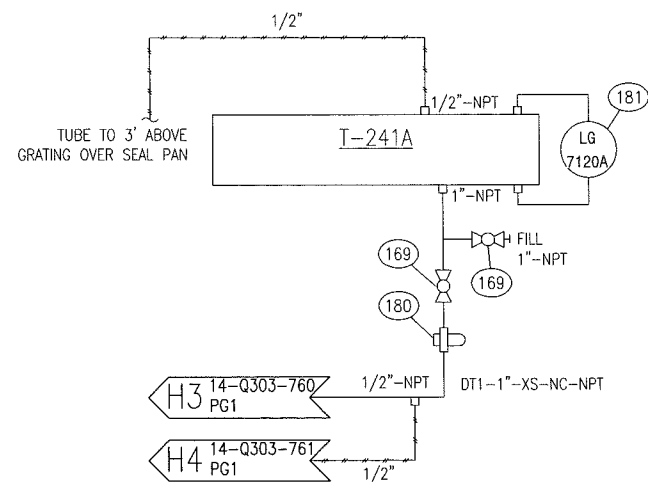

STANDARD TUBING SIZES	LINETYPE LEGEND	INSTRUMENTATION TAGGING LEGEND
*1/4" - 0.049"	PROCESS PIPING	○ LOCAL MOUNTED DEVICE
*3/8" - 0.049"	UTILITY PIPING	◐ PANEL MOUNTED DEVICE
1/2" - 0.049"	SEAMLESS TUBING	◑ OFF-SKID MOUNTED DEVICE
3/4" - 0.065"	ELECTRICAL WIRING	◒ SIGNAL TO PANEL
1" - 0.083"	INTERNAL LOGIC	◓ SIGNAL TO OFF-SKID
*PER CLIENT SPEC	OEM SUPPLIED	◔ PANEL LOGIC
	ASSEMBLY BOUNDARY	
	BUILDING WALL	
	DRIVETRAIN	
	CUSTOMER SUPPLIED	

THIS DRAWING IS SOLE PROPERTY OF BIDELL EQUIPMENT AND SHALL NOT BE REPRODUCED, COPIED, LENT, ALTERED NOR USED FOR ANY PURPOSE OTHER THAN WHICH IT IS FURNISHED EXCEPT WITH THE WRITTEN PERMISSION OF BIDELL EQUIPMENT

ISSUED FOR CONSTRUCTION

IFC

2015/07/27

UNIT NUMBER	
14-928	<input type="checkbox"/>
14-929	<input type="checkbox"/>
14-930	<input type="checkbox"/>

REV	DATE	DRAWN	REVIEWED	APPROVED	DESCRIPTION
A	15-06-19	GW	TT	GM	ISSUED FOR CONSTRUCTION
O	15-03-13	DM	GW	GM	ISSUED FOR APPROVAL

REVISIONS

MAIN SHOP / OFFICE
6900 - 112th AVENUE S.E.
CALGARY, AB T2C 4Z1
PHONE: (403) 235-5877
FAX: (403) 272-7749

BIDELL™ APEGA PERMIT NUMBER P08318
GAS COMPRESSION

HOLDING TANK UTILITY DIAGRAM
WEG 600HP ELECTRIC/ARIEL JGR/4/AIR-X-LIMITED 108EF
CUSTOMER: ENCAN c/o EQUINOX ENGINEERING
LOCATION: KAYBOB GAS PLANT
LSD: 15-31-062-21 WSM

SHEET#: 1 OF 1
JOB#: 14-Q303

PAPER SIZE 11"x17" SCALE NTS DWG# 14-Q303-711 REV A