


# Certificate of Inspection Permit

**SIGNALTA RESOURCES LIMITED**

BOX 6150 STATION D

CALGARY, AB  
T2P 2C7

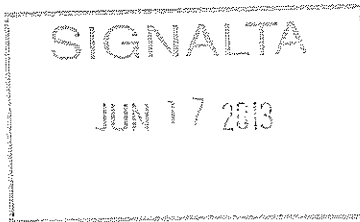

Max. Inspection Interval: 3 00 Yr.

Year Built: 1984

CRN: C9883 2

Serial #: 3671

Volume:

Heating Surface: 209.00 M2

Surface Area:

COMPANY CODE:

DESCRIPTION: PACKAGED FIRETUBE BOILER

LOCATION: LSD 13-14-42-16 W4M (FORESTBURG GAS PLANT)

MANUFACTURER: SASKATOON BOILER MANUFACTURING CO LTD

## Pressure Relief Valves

| PART  | MAX. ALLOWABLE<br>PRESSURE | MAX. TEMP | MIN. TEMP | VALVE ID | SETTING  | CAPACITY            | LOCATION |
|-------|----------------------------|-----------|-----------|----------|----------|---------------------|----------|
| SHELL | 1034 KPA                   | 204 C     |           | SV1      | 1034 KPA | 4461 KG/H ON VESSEL |          |
|       |                            |           |           | SV2      | 1034 KPA | 4461 KG/H ON VESSEL |          |

### Terms and Conditions:

Maintain proper water treatment.

'BOILER MUST BE SUPERVISED BY CERTIFIED POWER ENGINEERS'

Permit Issued by: AMUNDSON, WIL

Signature:

### NOTE: REQUIREMENTS OF THE SAFETY CODES ACT AND THE REGULATIONS ISSUED THEREUNDER:

An owner or vendor must notify the Administrator in writing when the pressure equipment identified on this certificate is sold or otherwise disposed of

The owner or person in charge shall report all accidents involving Pressure Equipment to the district Safety Codes Officer immediately and shall send a full report in writing to the Administrator as required by the Act. No repairs or alterations may be made unless authorized by a Safety Codes Officer.