

V-365
PROPANE TANK
 CAPACITY: 1000 gal


V-360
BUTANE BULLET
 SIZE: 3277mm I.D. X 22352mm S/S
 CAPACITY: 113m³ (54600 USWG)
 D.P. 1724 KPa @ 65C
 CR No. A7564 2

P-360
BUTANE PUMP
 MODEL: CORKEN F12 CD2A TURBINE
 MOTOR: 5 HP 3600 RPM 3/60/600V X.P.
 CAPACITY: 1.8m³/HR D.P. 730 KPa @ (106 PSIG)

P-361
CRUDE TRANSFER PUMP
 MODEL: GUILDS 3199 S/N 15X3-6
 MOTOR: 5 HP 1500 RPM 208/230/460V X.P.
 CAPACITY: 25m³/HR D.P. 205 KPa @ (30 PSIG)

BH-100
BUILDING HEATER
 MODEL: RUFRIECK
 DUTY: 3 kW
 MOTOR: 3/60/600V XP

BF-100
BUILDING FAN
 CAPACITY: 6 ACPH
 MOTOR: 120/1/60 X.P.

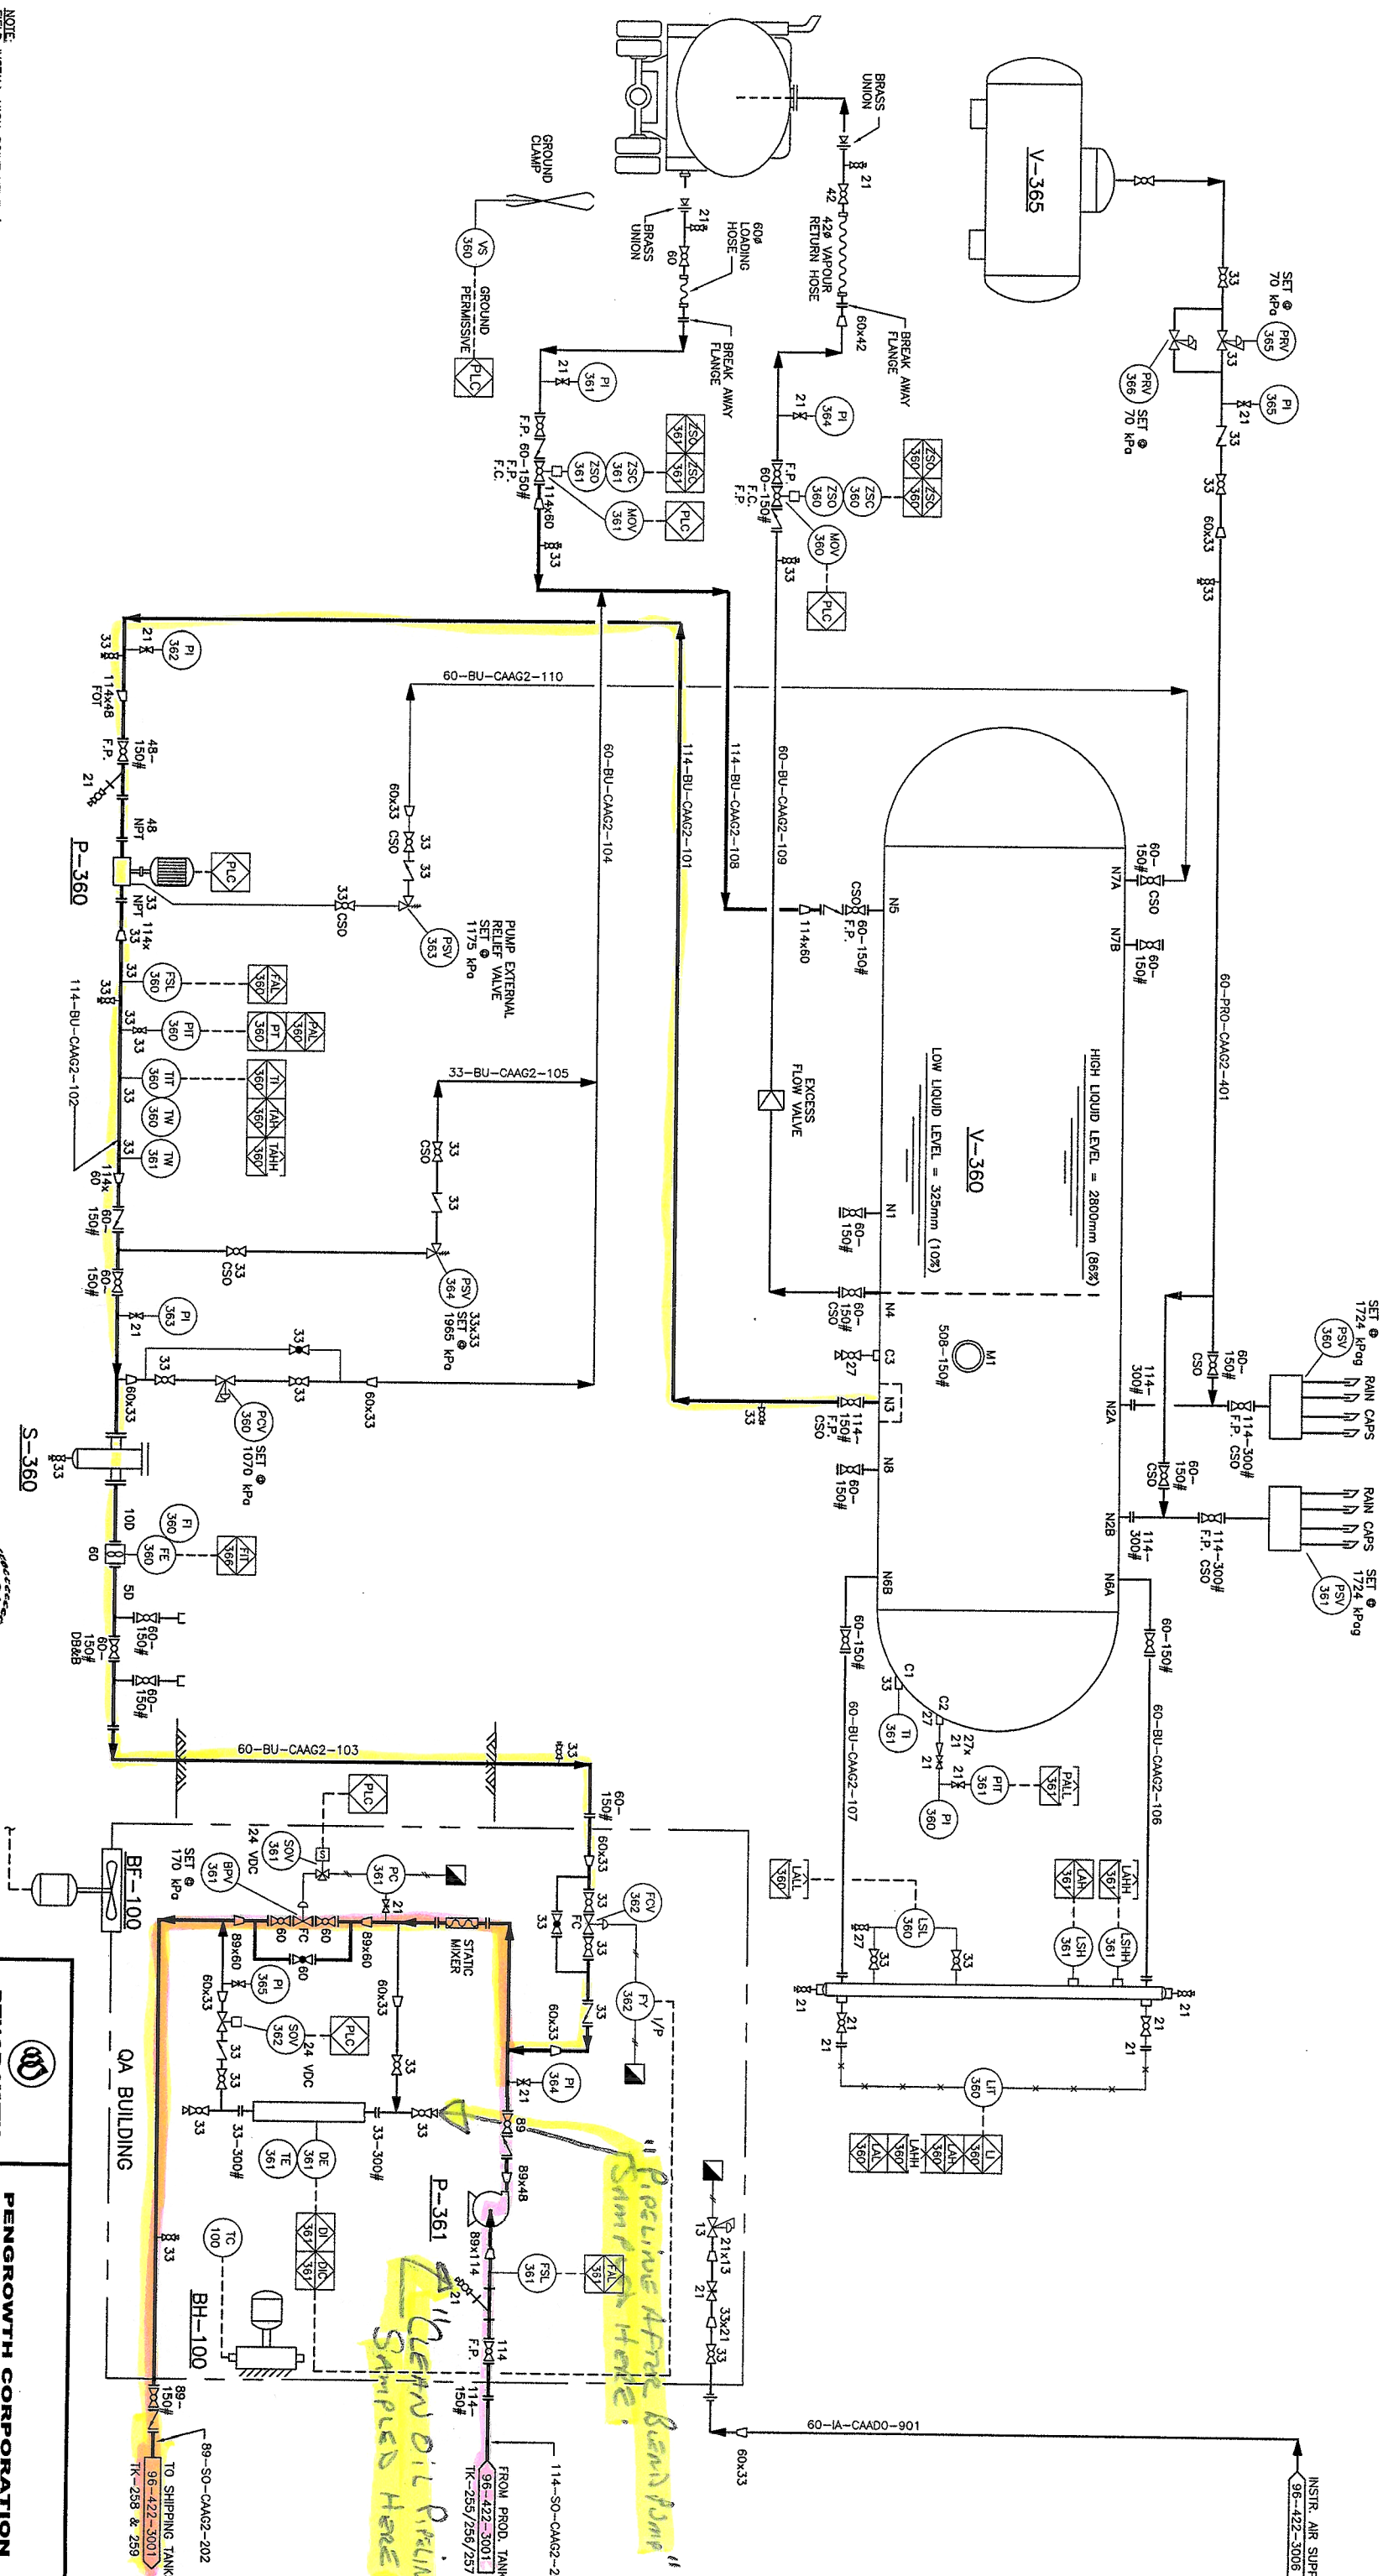

NOTE
 FIELD INSTALL HIGH POINT VENTS/DRAINS AS REQUIRED

NO.	DATE	REVISIONS	DRAWING	CHECK	DESIGN	APPR	NO.	TITLE
0	04-11-08	ISSUED FOR CONSTRUCTION	ME	AB				
B	04-11-04	ISSUED FOR OGC APPLICATION	ME					
A	04-09-17	ISSUED FOR CLIENT APPROVAL	E.O.					

SEAL/STAMP-REV.	SEAL/STAMP-REV.

APPROVED FOR CONSTRUCTION	DATE	REV

PENGROWTH		PENGROWTH CORPORATION	
CONTRACTOR NAME	CONCISE DESIGN	SCALE	PENGROWTH DRAWING NUMBER
BUTANE BULLET & PUMP ADDITION	NTS		XXX-XXXX-XXX-XXX
CONTRACTOR DRAWING NUMBER	REV	SHEET	
422-24-3001	0		