



BILL OF MATERIALS OF RTU PANEL				
TEM	QTY	DESCRIPTION	MANUFACTURER	SUPP'D
1	1	FISHER ROC407 FLOBOSS, 24VDC, OUTSIDE SERVICE TEMP -40°C TO 75°C, SUITABLE FOR CLASS I DIV 2	FISHER ROC407 FLOBOSS	OWNER
2				
3	1	PULSE INPUT (SOURCE) MODULE	FISHER FSPI-1H	OWNER
4	1	ANALOG OUTOUT (SOURCE) MODULE	FISHER FSAO-1H	OWNER

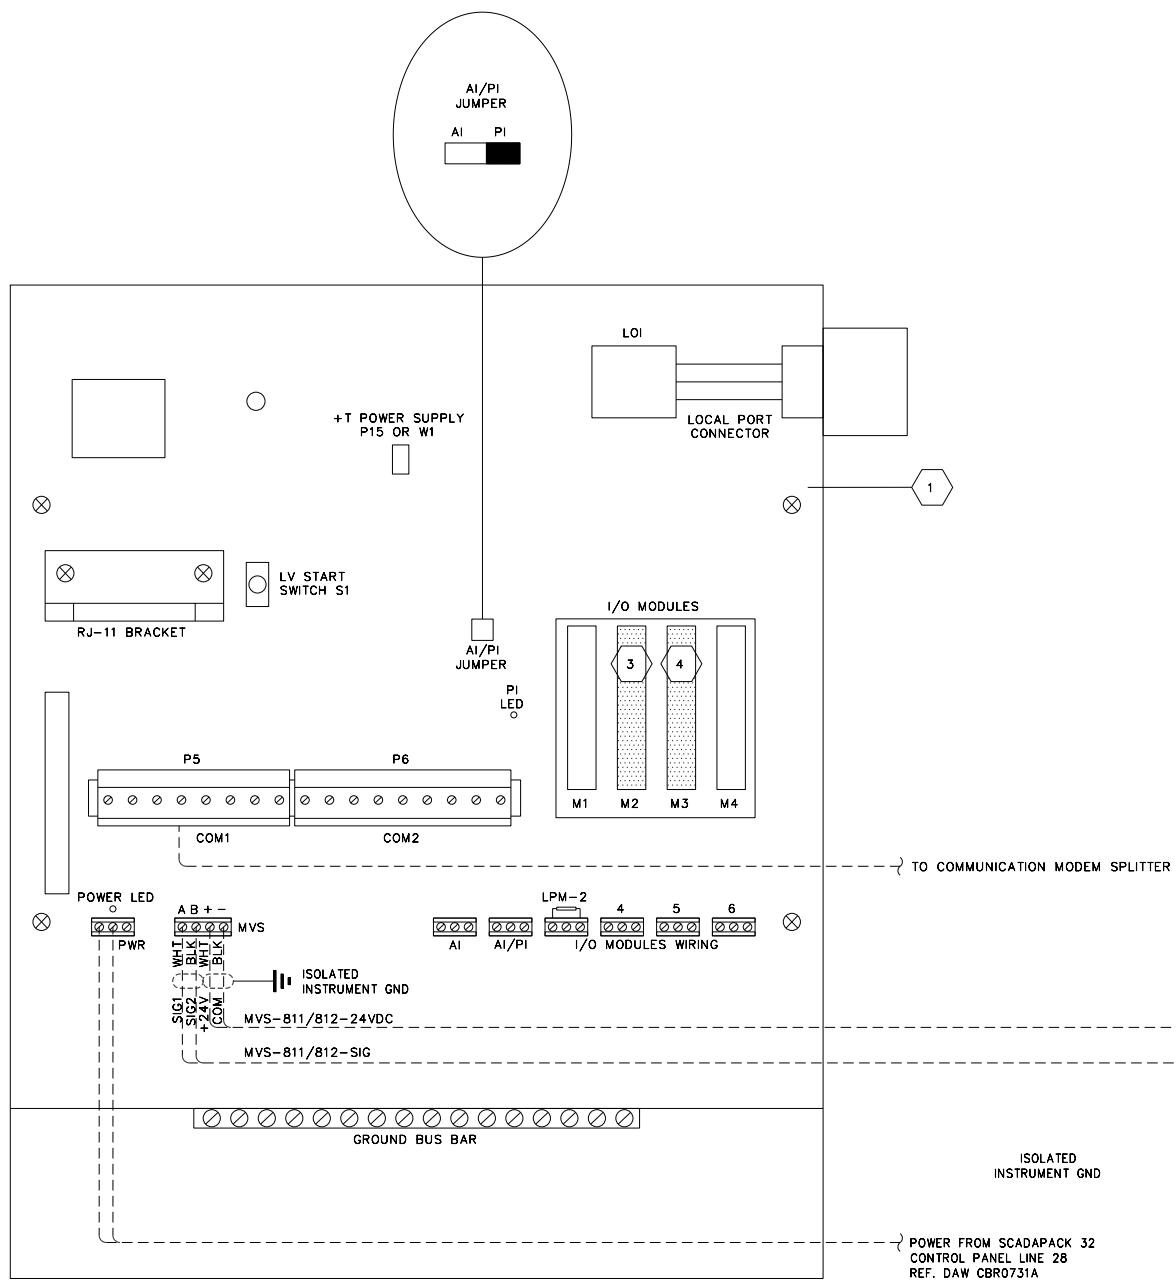

ROC407 FLOBOSS REMOTE OPERATIONS CONTROLLER LAYOUT

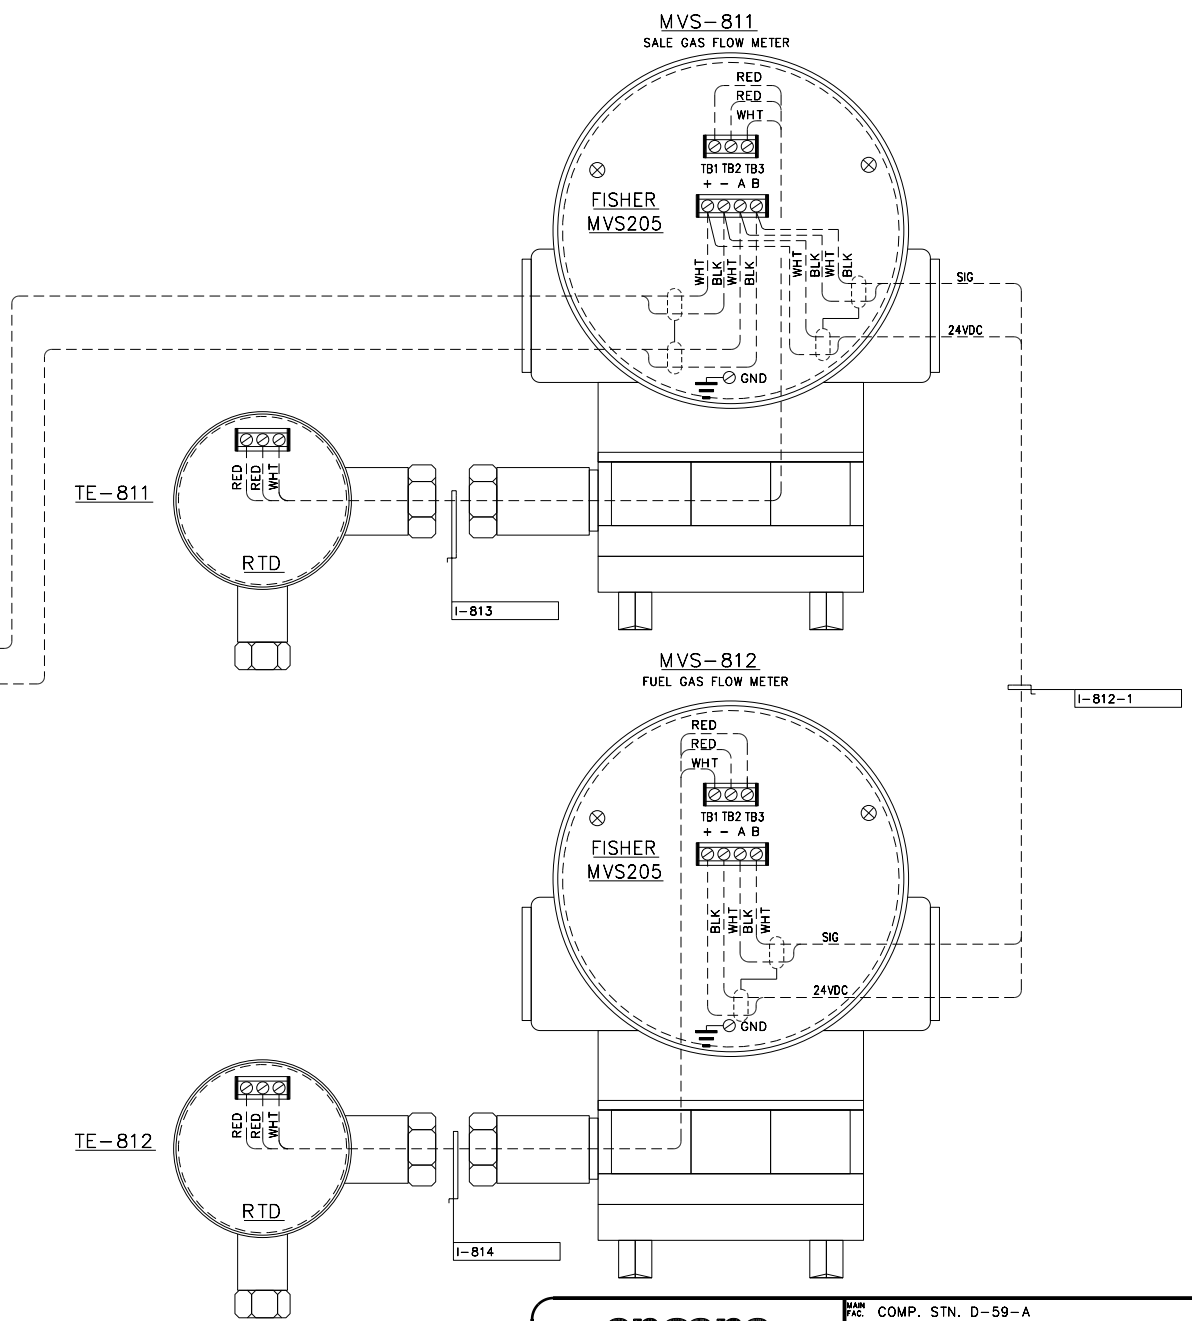

PLotted: 2010-11-02 4:09:51 PM BY: EGYULAI
 LAST SAVED: 2010-11-02 4:09:51 PM BY: EGYULAI

CAUTION : READ BEFORE EXCAVATION
 ALL EXCAVATIONS MUST BE CARRIED OUT AS PER
 "ENCANA'S GROUND DISTURBANCE PRACTICE"

NO.	DATE	PROJECT DESCRIPTION	PROJ.	AFE	EPCM Co.	EPCM No.	APPD.
1	2005-01-20	COMPRESSOR ADDITION - RE-ISSUED FOR CONSTRUCTION	-	-	CIMARRON	ECC561	CFB
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-

REV. NUMBER	ISSUE STAGE	DATE	BY	CHKD.	APPD.
1C	Prelim.	2005-01-17	KL	PH	CFB
-	Bid	-	-	-	-
-	Constr.	2005-01-20	KL	PH	CFB
-	As-built	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-

encana.
natural gas

COMP. STN. D-59-A
 D-59-A/93-P-8
 COMPRESSOR STATION
 D-59-A/93-P-8
 SCALE: 1:5 (A1 Size) EPCM No. ECC561

EPCM Co. CIMARRON ENGINEERING LTD.
 TITLE: FLOBOSS 407 RTU PANEL LAYOUT
 G-800 DEHYDRATION BUILDING

AREA: CUTBANK RIDGE CLASS: J FILE NO.: CBR0734A