


NOTES:

1. INDIVIDUAL PAIR/TRIAD SHOULD BE LABELED AS A WHOLE WITH A DEVICE TAG.
2. LAMACOIDS TO BE BLACK ON WHITE BACKGROUND UNLESS SPECIFIED.
3. INSTRUMENT CABLES ARE TO BE TERMINATED ON THE LEFT HAND SIDE OF THE TERMINAL STRIP. HOMERUN CABLES ARE TERMINATED ON THE RIGHT HAND SIDE.
4. LAMACOID TO BE WHITE ON RED BACKGROUND. SEE DETAIL 1.
5. WIREWAY TO BE MINIMUM 2" FROM TERMINALS.
6. 24VDC FIELD WIRING.
7. 24VDC HOMERUN WIRING.
8. 120VAC FIELD WIRING.
9. 120VAC HOME RUN WIRING.

LAMACOID LIST					
ITEM	QTY.	DESCRIPTION	SIZE (mm)	SUPPLIER	
A	1	001-JBF-21-1009	20mm TEXT	50x300	VENDOR
B	1	TS-1	5mm TEXT	10x20	VENDOR
C	1	TS-2	5mm TEXT	10x20	VENDOR
D	1	(SEE DETAIL 1)	5mm TEXT	100x150	VENDOR
E	-	-	-	-	VENDOR
F	-	-	-	-	VENDOR
G	-	-	-	-	VENDOR
H	-	-	-	-	VENDOR
I	-	-	-	-	VENDOR
J	-	-	-	-	VENDOR
K	-	-	-	-	VENDOR
L	-	-	-	-	VENDOR
M	-	-	-	-	VENDOR
N	-	-	-	-	VENDOR

MATERIAL LIST					
ITEM	QTY.	DESCRIPTION	MANUFACTURER	CATALOG NO.	SIZE
1	1	JUNCTION BOX NEMA 4X c/w BACKPAN	HOFFMAN	A20H2008GQRLP	-
2	-	JUNCTION BOX NEMA 4X c/w BACKPAN	HOFFMAN	A20P20	-
3	AS REQ'D	DIN RAIN TERMINAL STRIP	WEIDMULLER	TS 32	-
4	AS REQ'D	TERMINAL STRIP END BRACKET	WEIDMULLER	EWK-1	-
5	AS REQ'D	TERMINAL MARKER	WEIDMULLER	SCHT 5	-
6	-	SAK 2.5 FEED THROUGH TERMINAL	WEIDMULLER	SAK 2.5	-
7	80	SAK 4 FEED THROUGH TERMINAL	WEIDMULLER	SAK 4	-
8	-	SAK 6 FEED THROUGH TERMINAL	WEIDMULLER	SAK 6	-
9	1	COVER/GASKET AND BREATHER DRAIN	CROUSE-HINDS	ECD385	-
10	1	200mm GROUND BUS C/W KAZU LUG	OPEN	-	-
11	AS REQ'D	GREY WIREWAY c/w COVER	PANDUIT	-	1" x 3"
12	AS REQ'D	WHITE WIREWAY c/w COVER	PANDUIT	-	1" x 3"
13	AS REQ'D	METAL SEPARATOR BARRIER	OPEN	-	-
14	1	END PLATE	WEIDMULLER	AP SAK4-10	-
15	1	CORROSION INHIBITOR	CROUSE-HINDS	CID-101	-

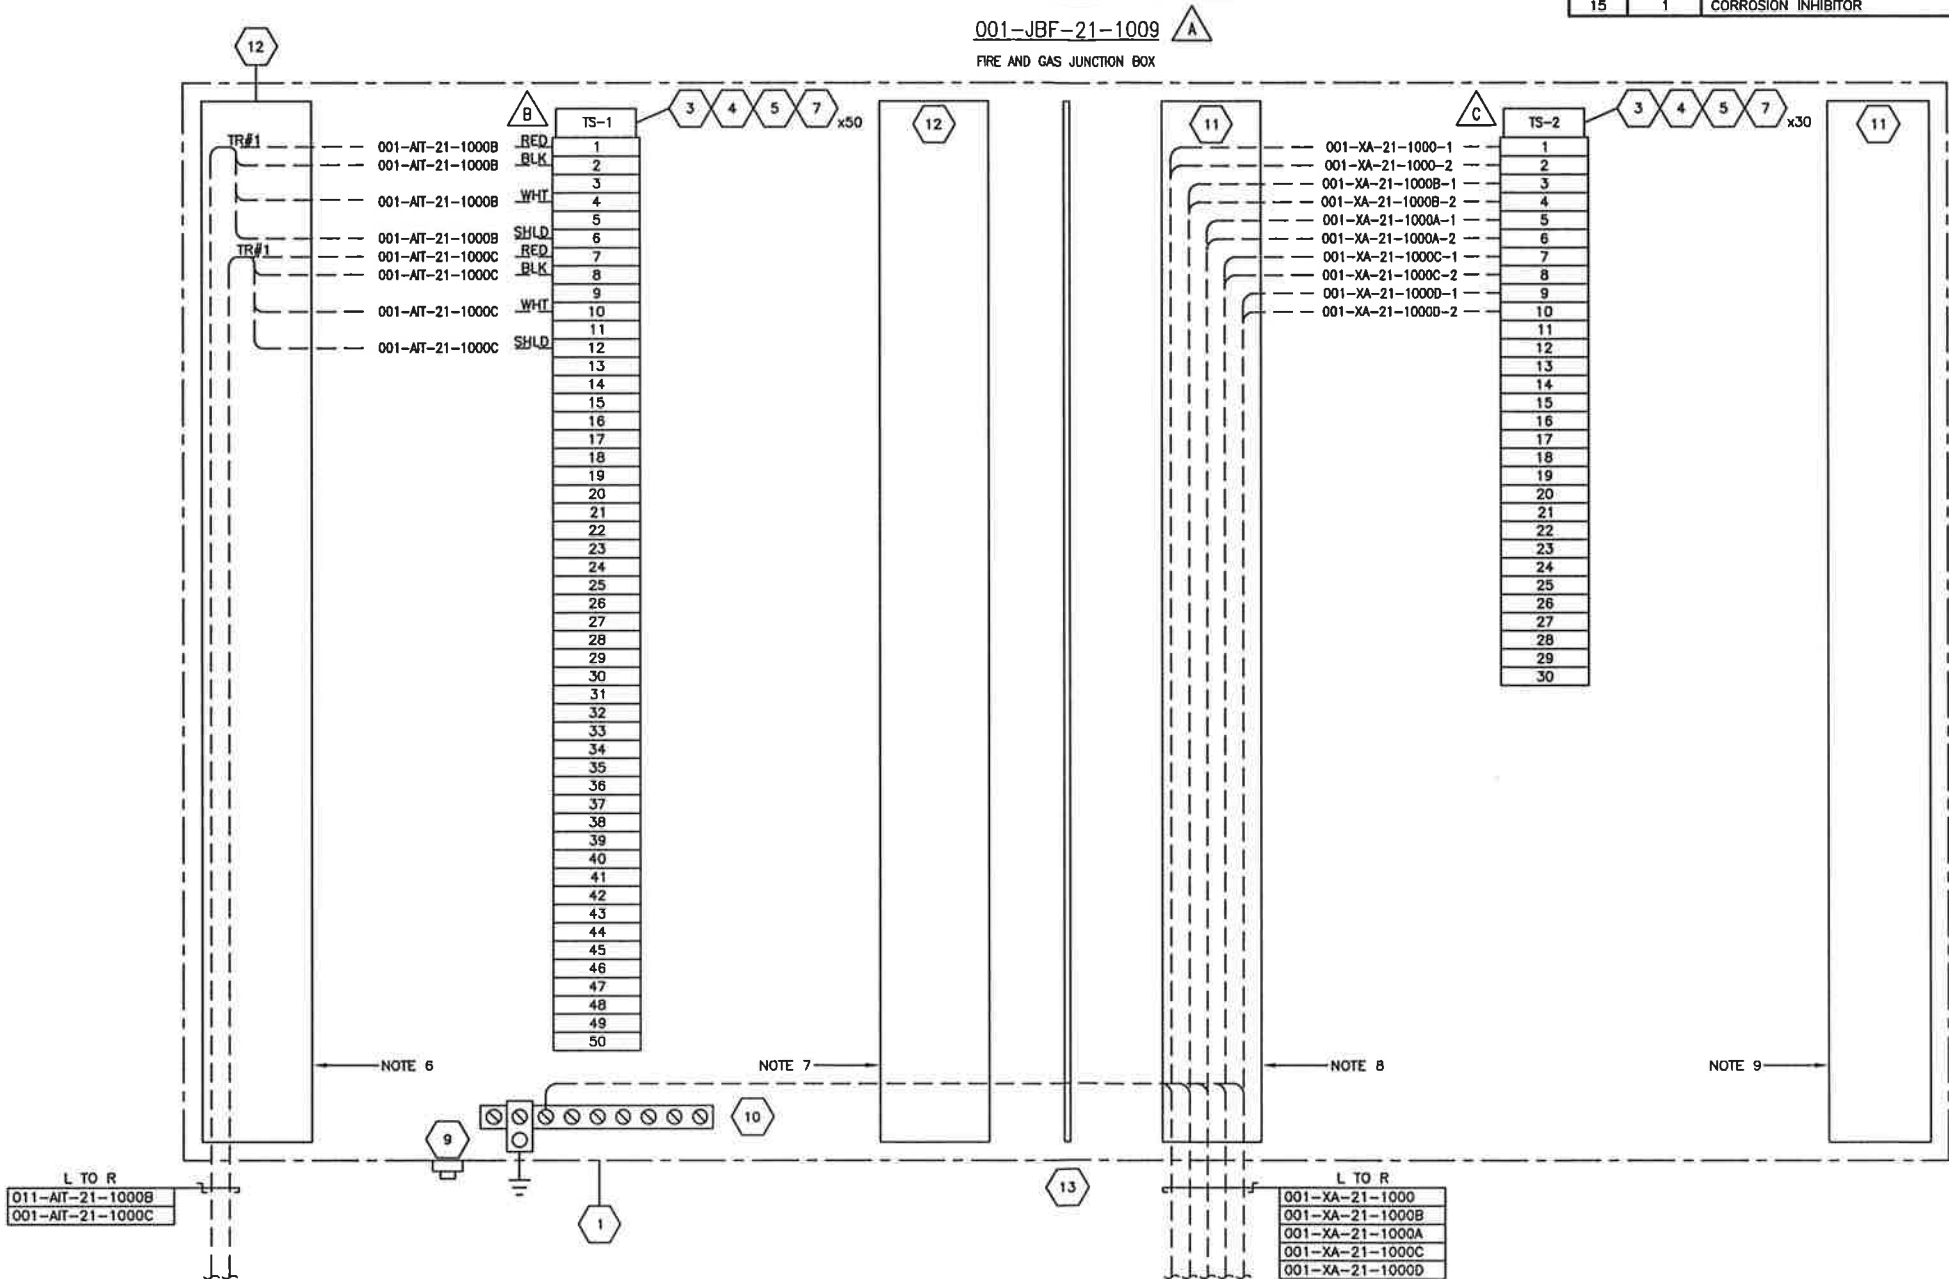

WorleyParsons
resources & energy
REVIEW STAMP

PROJECT NO. _____

1. REVIEWED & ACCEPTED
MANUFACTURE MAY PROCEED. ☒

2. REVIEWED & ACCEPTED AS
MARKED. REVISE & RE-SUBMIT
MANUFACTURE MAY PROCEED. ☐

3. REVISE AS MARKED AND
RE-SUBMIT. MANUFACTURE
SHALL NOT PROCEED. ☐

4. REVIEW NOT REQUIRED.
FOR INFORMATION ONLY.
MANUFACTURE MAY PROCEED. ☐

Acceptance in any of these
categories in no way relieves the
Contractor/Supplier of its
responsibility for the due and
proper performance of the work
in accordance with the
Contract/Purchase Order

NAME: Mohsen Hemmati
SIGNED: MH
DATE: JUL 13 2014

DATE	JOB NO.	PURCHASE ORDER NO.
06/23/2014	407014-00120	ME-POD-0011
VTRI-2331A		
DEVON MR. NO		
FE-CPF-M011		
EQUIP. NO.	WORLEYPARSONS VP NO.	REV.
001-PK-21-1000	407014-00120-ME-POD-0011-0049	4

D	ISSUED FOR REVIEW	JDA	18JUN2014	TF	
REV	DESCRIPTION	BY	CHK	DATE	CHK
		DRAFTING			ENGINEER

X					
REFERENCE DRAWING					

devon

NEDG

COB UTILITY HEAT MEDIUM PACKAGE
TAG: 001-PK-21-1000

FIRE AND GAS
JUNCTION BOX DETAILS

DRAWN BY:	SCALE:	JOB NUMBER:	DRAWING NUMBER:	REV NO:
NAB	NTS	1928NE	1928NE-ELC-5570	D