


NOTES:

1. INDIVIDUAL PAIR/TRIAD SHOULD BE LABELED AS A WHOLE WITH A DEVICE TAG.
2. LAMACOIDS TO BE BLACK ON WHITE BACKGROUND UNLESS SPECIFIED.
3. INSTRUMENT CABLES ARE TO BE TERMINATED ON THE LEFT HAND SIDE OF THE TERMINAL STRIP.
HOMERUN CABLES ARE TERMINATED ON THE RIGHT HAND SIDE.
4. LAMACOID TO BE WHITE ON RED BACKGROUND. SEE DETAIL 1.
5. WIREWAY TO BE MINIMUM 2" FROM TERMINALS.
6. 24VDC FIELD WIRING.
7. 24VDC HOMERUN WIRING.
8. 120VAC FIELD WIRING.
9. 120VAC HOME RUN WIRING.

LAMACOID LIST					MATERIAL LIST							
ITEM	QTY.	DESCRIPTION	SIZE (mm)	SUPPLIER	ITEM	QTY.	DESCRIPTION	MANUFACTURER	CATALOG NO.	SIZE	SUPPLIER	
A	1	002-JBF-21-2009	20mm TEXT	50x300	VENDOR	1	1	JUNCTION BOX NEMA 4X c/w BACKPAN	HOFFMAN	A20H2008GORLP	-	VENDOR
B	1	TS-1	5mm TEXT	10x20	VENDOR	2	-	JUNCTION BOX NEMA 4X c/w BACKPAN	HOFFMAN	A20P20	-	VENDOR
C	1	TS-2	5mm TEXT	10x20	VENDOR	3	AS REQ'D	DIN RAIN TERMINAL STRIP	WEIDMULLER	TS 32	-	VENDOR
D	1	(SEE DETAIL 1)	5mm TEXT	100x150	VENDOR	4	AS REQ'D	TERMINAL STRIP END BRACKET	WEIDMULLER	EWK-1	-	VENDOR
E	-	-	-	-	VENDOR	5	AS REQ'D	TERMINAL MARKER	WEIDMULLER	SCHT 5	-	VENDOR
F	-	-	-	-	VENDOR	6	-	SAK 2.5 FEED THROUGH TERMINAL	WEIDMULLER	SAK 2.5	-	VENDOR
G	-	-	-	-	VENDOR	7	80	SAK 4 FEED THROUGH TERMINAL	WEIDMULLER	SAK 4	-	VENDOR
H	-	-	-	-	VENDOR	8	-	SAK 6 FEED THROUGH TERMINAL	WEIDMULLER	SAK 6	-	VENDOR
I	-	-	-	-	VENDOR	9	1	COVER/GASKET AND BREATHER DRAIN	CROUSE-HINDS	ECD385	-	VENDOR
J	-	-	-	-	VENDOR	10	1	200mm GROUND BUS C/W KA2U LUG	OPEN	-	-	VENDOR
K	-	-	-	-	VENDOR	11	AS REQ'D	GREY WIREWAY c/w COVER	PANDUIT	-	1" x 3"	VENDOR
L	-	-	-	-	VENDOR	12	AS REQ'D	WHITE WIREWAY c/w COVER	PANDUIT	-	1" x 3"	VENDOR
M	-	-	-	-	VENDOR	13	AS REQ'D	METAL SEPARATOR BARRIER	OPEN	-	-	VENDOR
N	-	-	-	-	VENDOR	14	1	END PLATE	WEIDMULLER	AP SAK4-10	-	VENDOR
						15	1	CORROSION INHIBITOR	CROUSE-HINDS	CID-101	-	VENDOR

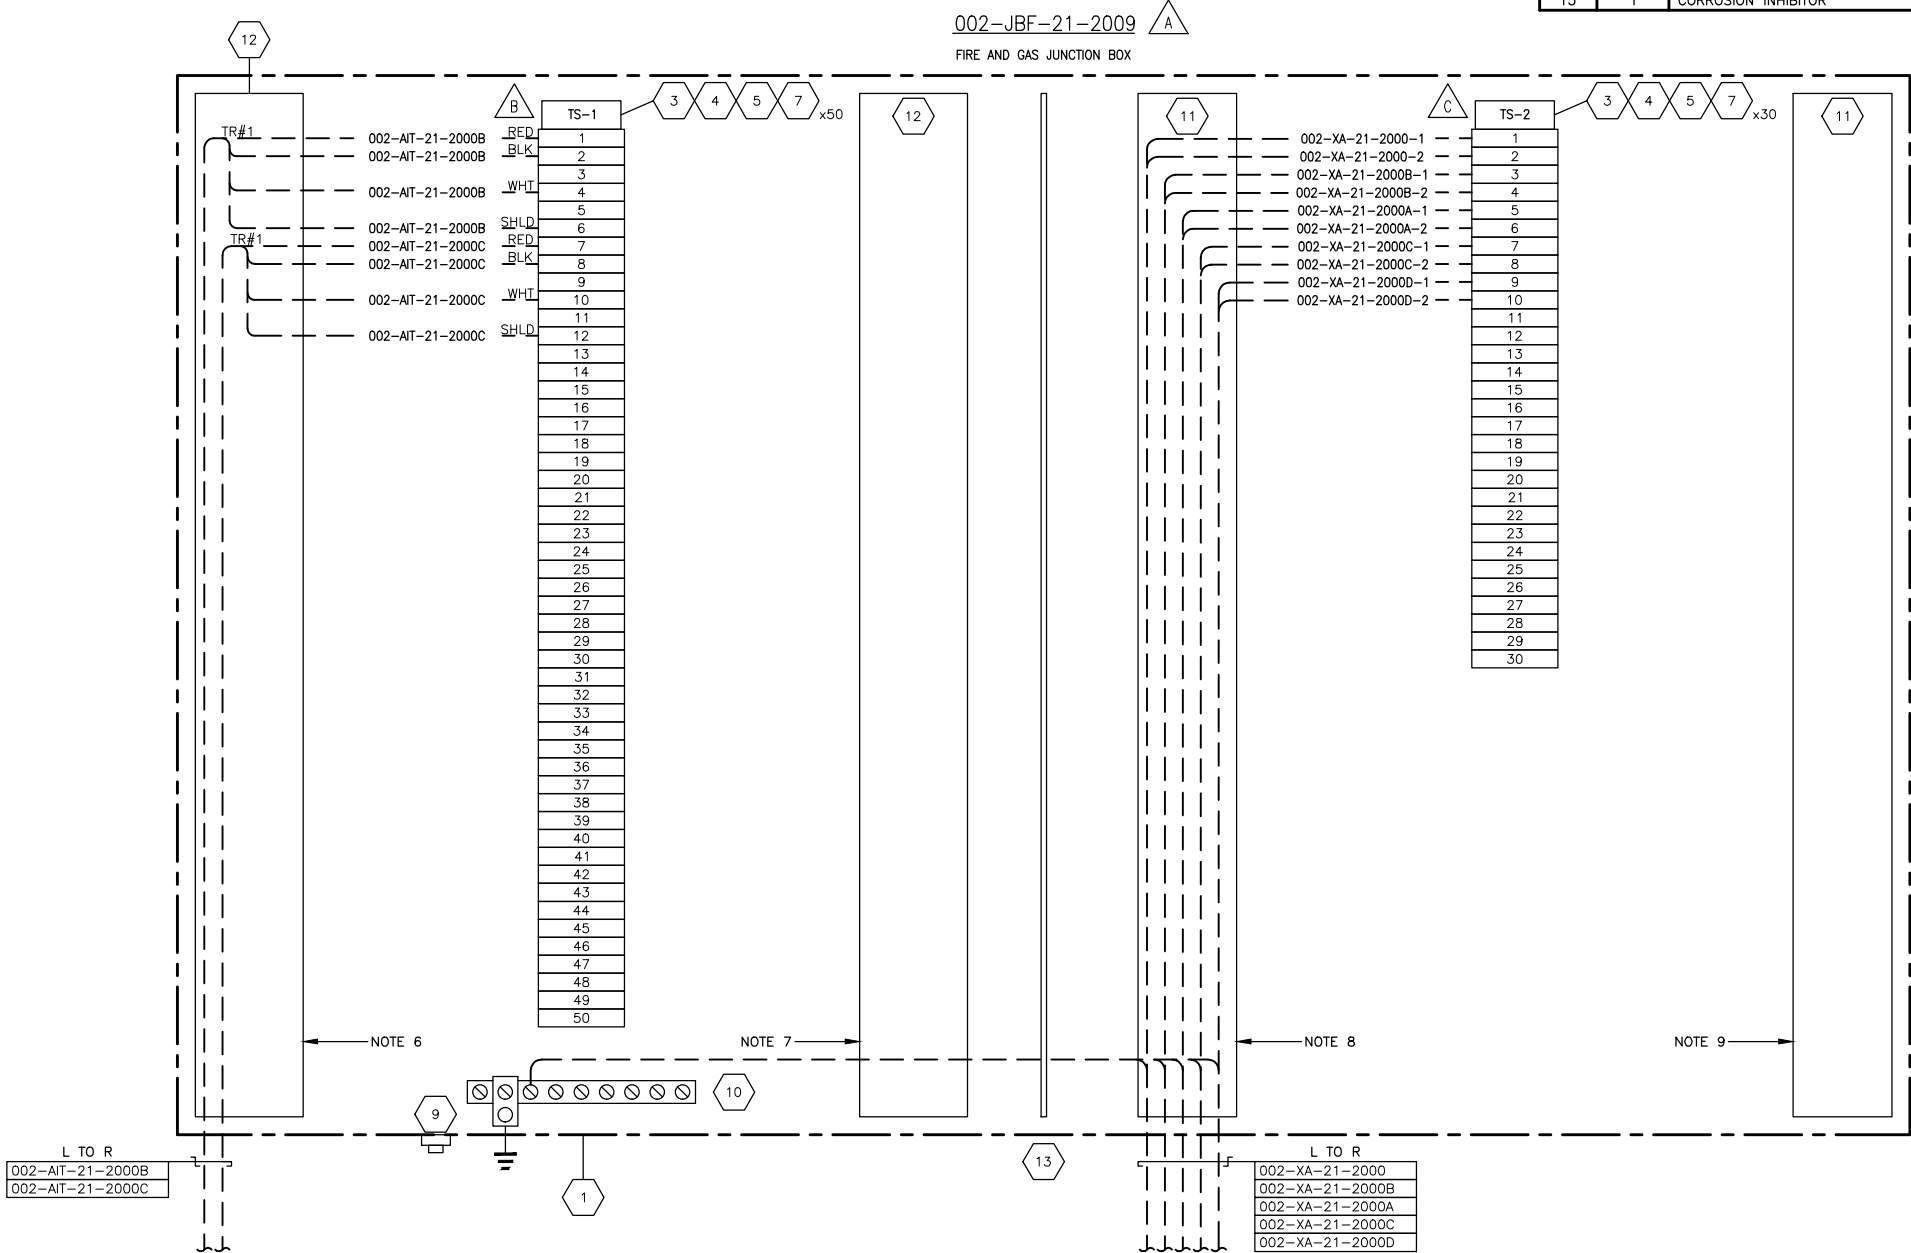

GENERAL NOTES:

REVISIONS

Acero Engineering Inc.

This drawing is prepared solely for the use of the contractual customer of Acero Engineering (Acero) and Acero assumes no liability to any other party for any representations contained in this drawing.

P.ENG.	DATE	14 07 25
APP.	TF	DATE
CKD.	-	DATE
DEN.	-	DATE
DWN.	GMK	DATE

ENGINEERING RECORD

LEP UTILITY HEAT MEDIUM PACKAGE
TAG: 002-PK-21-2000
FIRE AND GAS
JUNCTION BOX DETAILS

CLIENT DRAWING NUMBER

SCALE

ACERO DRAWING No.

REV.

DRAWING NUMBER

REFERENCE DRAWINGS

REV.

DATE

YY

MM

DD

DESCRIPTION

GMK

-

-

TF

DWN.

CKD.

DES.

APP.

PERMIT STAMP AND PROFESSIONAL STAMP
AFFIXED ABOVE SHALL APPLY ONLY TO REV(S)

A

91-LEPUTIL-5500

NTS

91-LEPUTIL-5500

A