


EF-550  
EXHAUST FAN  
120VAC 1PHASE 60HZ

P-500  
NETZSCH PUMP  
Bomba Nemo  
Mod. NM125SY045242

BH-550  
BUILDING HEATER  
MAKE: RUFENCOX 15KW  
MODEL: THERMOSTAT  
C/W XP THERMOSTAT

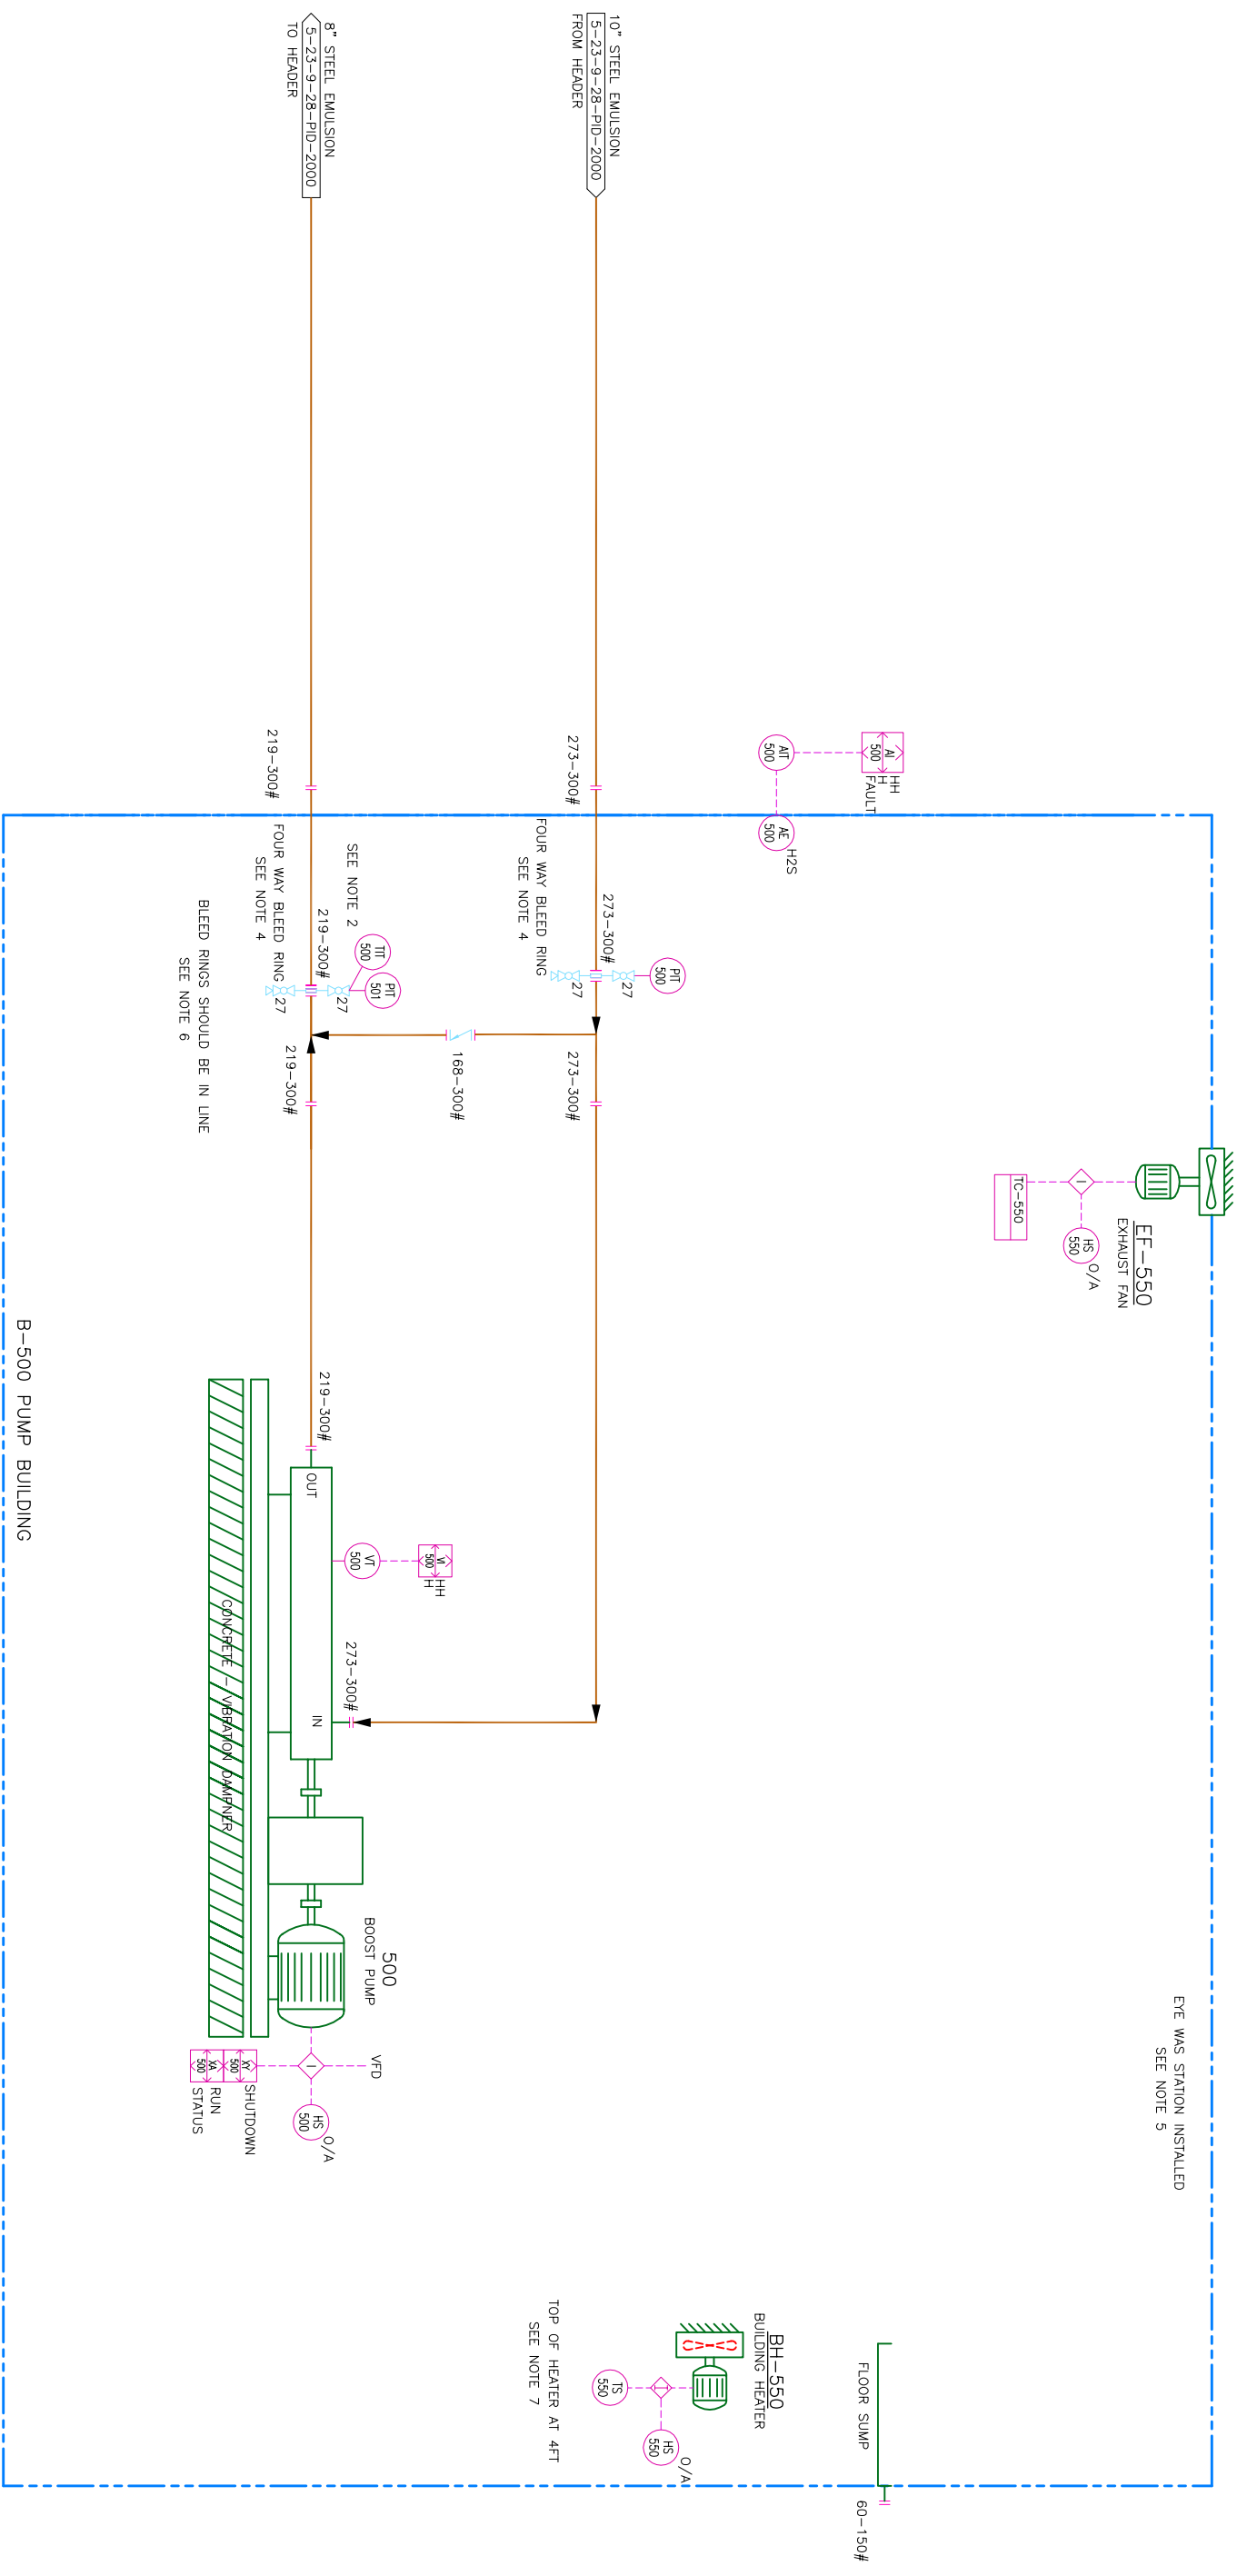


NOTES:  
SKID TO BE CONCRETE FILLED UNDER PUMP FOR VIBRATION DAMPENING  
3\"/>

NOTES:

- 2 - TIT TO BE INSTALLED ON THE TOP PORT OF THE FOUR WAY BLEED RING AND PIT TO BE INSTALLED ON THE SIDES
- 3 - EXCEPTION - "B" PIPE SPEC
- 4 - BLEED RINGS ARE TO BE 4 WAY BLEED RINGS IT #3 TAPS ALL THE WAY THROUGH
- 5 - EYE WASH STATION INSTALLATION REQUIRED
- 6 - BLEED RING AND FLANGES SHOULD BE IN LINE
- 7 - TOP OF HEATER INSTALLED AT 4 FT

REV	DESCRIPTION	BY	DATE	CHK	APP
0	ISSUED FOR REVIEW	LJ	10/13/2015	-	-

REFERENCE DRAWING
-



**TUNDRA**  
OIL & GAS PARTNERSHIP

DALY  
5-23-9-28 W1M  
PROCESS & INSTRUMENTATION DIAGRAM  
BOOST PUMP BUILDING

DRAWN BY: LJ	SCALE: NTS	AFF: A	DRAWING NUMBER: 5-23-9-28W1M-PID-2005	REV NO: A
--------------	------------	--------	---------------------------------------	-----------