


XIO JUMPER SETTINGS			
JUMPER	EXPLANATION	SILKSCREEN	SETTING
JP3	Pulse Generator (PG) power supply level selection. "P15" = +15VDC power supply "P5" = +5VDC power supply	[P15]	1-2
		[P5]	2-3
JP4	Motor temperature sensor type selection. External transducer required when using 100 ohm sensor. "PT" = 1k ohm platinum motor temperature sensor "RTD" = 100 ohm platinum motor temperature sensor	[PT]	2-3
		[RTD]	1-2

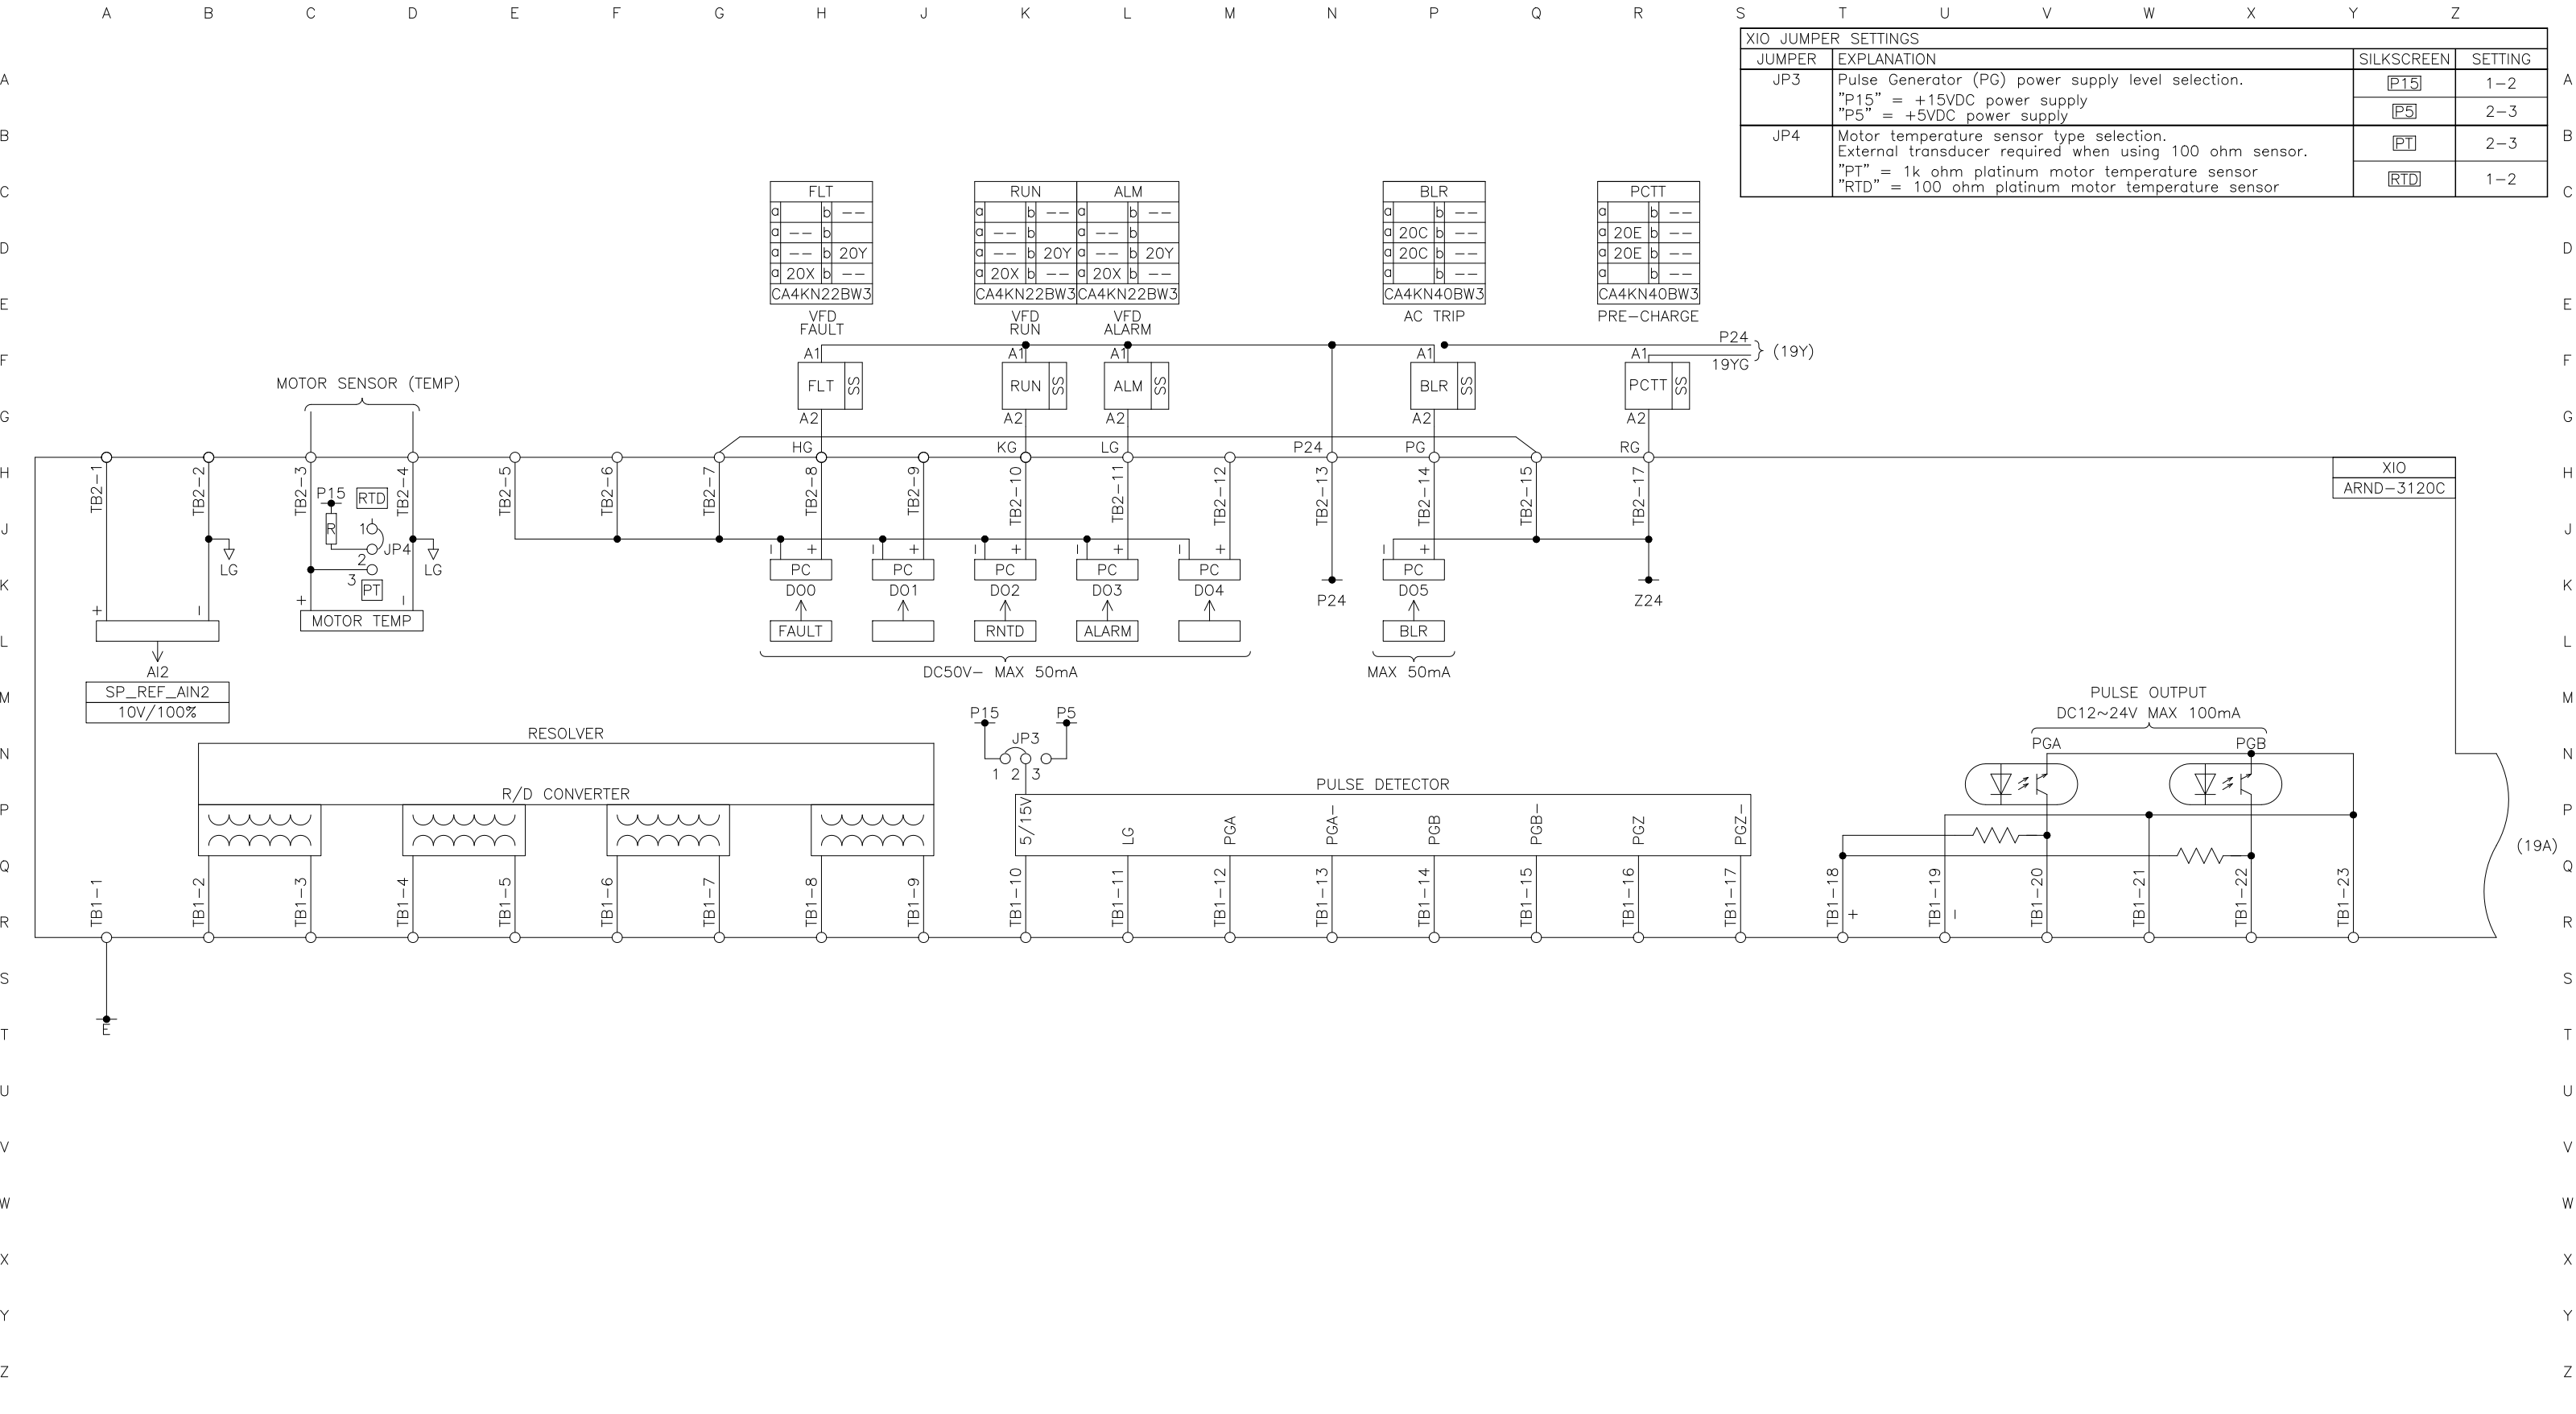

4					
3					
2					
1					
0	06/16/11	FIRST ISSUE	CA	AL	AL
REV	DATE	DESCRIPTION	BY	CHK	APPR

**TOSHIBA**  
**TOSHIBA INTERNATIONAL CORPORATION**  
 MADE IN HOUSTON, TEXAS U.S.A.

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE:  
 EXTERNAL I/O (1)  
 TOSVERT-300MVi

CUSTOMER:  
 TUNDRA PROCESS SOLUTIONS

PROJECT NUMBER:  
 145718

REVISION:  
 0

SCALE:  
 NTS

DRAWING NUMBER:  
 145718318018