



ELEVATION
SOME DETAILS
OMITTED FOR CLARITY

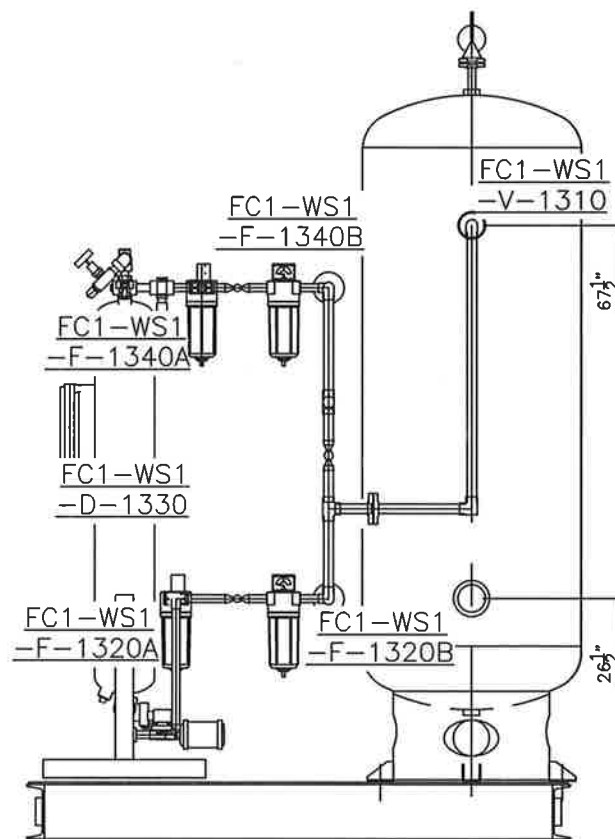

SECTION A-A
SOME DETAILS
OMITTED FOR CLARITY

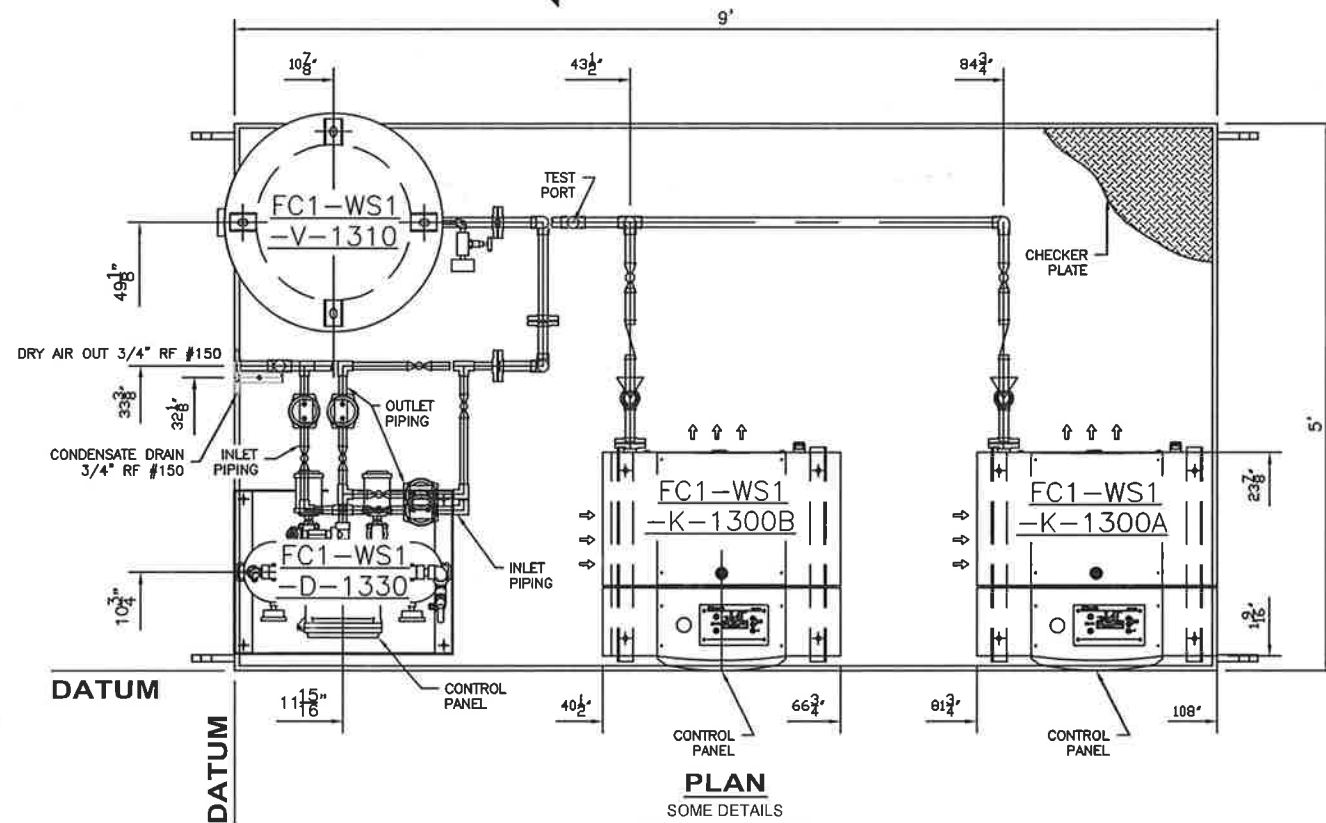

PLAN
SOME DETAILS
OMITTED FOR CLARITY

PO #	Job #	W191126
P482340	Doc #	V2553-191126- 1012
Equip #	VDR:	A7, A12, A13
	Rev:	4

Document #	Rev
<input checked="" type="checkbox"/> 1. Approved (Work May Proceed)	
<input type="checkbox"/> 2. Approved with Comments - Work May Proceed (Revise and Resubmit)	
<input type="checkbox"/> 3. Not Approved (Stop Work per Attached Instructions)	
<input type="checkbox"/> 4. Information Only	

AUTHORIZATION TO PROCEED DOES NOT WAIVE SUPPLIER'S RESPONSIBILITY OR LIABILITY UNDER THE CONTRACT / PURCHASE ORDER FOR COMPLIANCE WITH THE REQUIREMENTS OF THE DRAWINGS AND SPECIFICATIONS

Signature: *Dylan Vorp* 20/02/06
YY/MM/DD
PROPAK SYSTEMS LTD - AIRDRIE, AB

MAJOR EQUIPMENT LIST

TAG NO.	QTY.	DESCRIPTION	LBS.
FC1-WS1-K-1300A/B	2	COMPRESSOR, COMPAIR/GD L07, 10 HP, 36 SCFM @105 PSIG, 575V/3PH/60Hz	1162
FC1-WS1-D-1330	1	HEATLESS AIR DRYER, NW40-Y 42 SCFM @ 105 PSIG, 115V/1PH/60Hz	225
FC1-WS1-V-1310	1	AIR RECEIVER, 120GAL, SAMUEL TBA	330
FC1-WS1-F-1320A/1320B	2	PRE-FILTER, COALESCING, ASCO F901D-04GZ	10
FC1-WS1-F-1340A/1340B	2	AFTER-FILTER, COALESCING, ASCO F901H-04GZ	10
NW2655SK	1	STRUCTURAL SKID, C6 x 8.2 CHANNEL	993
-		PIPING & MISC.	200
(APPROX.) TOTAL WEIGHT			2930

- THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION UNLESS STAMPED 'ISSUED FOR CONSTRUCTION'.
- ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.
- ALL WELDS TO BE 1/4" FILLET UNLESS OTHERWISE NOTED.
- REFER TO NW 2165PF FOR GENERAL PIPING NOTES
- AIR RECEIVERS AND PIPING PAINTED AS PER NWE SPEC: (1) COAT PRIMER, (2) COATS ENAMEL WARM GREY.
- AIR RECEIVERS AND PIPING SURFACE PREPARATION SSP3-SP3.

REV	DESCRIPTION	DATE	DWN	CHK
4	REVISED CHANGES & RE-ISSUED FOR CONSTRUCTION	2020-01-30	HH	HAY
3	REVISED MARKUPS & RE-ISSUED FOR CONSTRUCTION	2020-01-10	HH	HAY
2	REVISED & ISSUED FOR CONSTRUCTION	2019-12-19	HH	HAY
1	REVISED & RE-ISSUED FOR APPROVAL	2019-11-29	HH	HAY
0	ISSUED FOR APPROVAL	2019-10-25	HH	HAY



GENERAL ARRANGEMENT

DUPLIX COMPAIR/GD L07-130 INSTRUMENT AIR COMPRESSOR PACKAGE (FC1-WS1-PK-1300)			
CLIENT	CENOVUS C/O PROPAC	SCALE	NTS
LOCATION	FOSTER CREEK WEST PADS SAP, AB	DWN BY	HH
LSD	TBA PO# P482340	DATE	2019-10-25
JOB	DWG	SHEET	REV
NW2165-RH	NW2165GA	1 / 1	4