
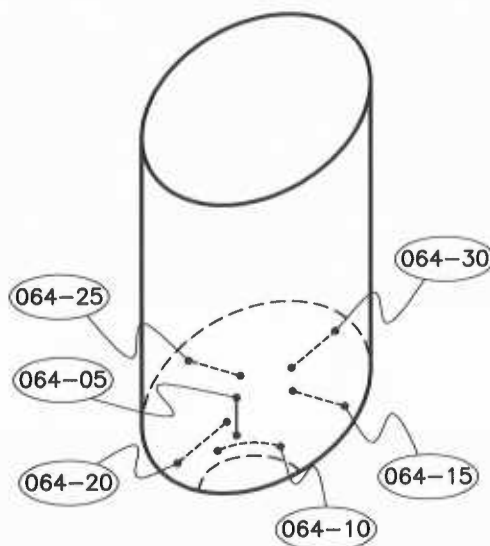


TEAM**Industrial Services**
Inspection Services Canada

66177249

P&ID. # _____
REF. # _____**VESSEL DATA**

P.E. No. T-320 Serial No. 10-797-1 Prov. Reg. No. N/S C.R.N. N/S
MFR. GLM Code/Div. 12F Para 12 Code Stamp X
Yr. Bld. 2011 Manway YES Vessel Size 144" X 240" Service WATER PWHT NO
PSV# N/S SAP# N/S RT N/S Insulated YES
Natnl. Board# N/S

Nominal Thickness & Material

Head: N/S Mat'l: N/S C.A.: N/S Repairs _____
Head: _____ Reason _____
Shell: 4.8mm A-36 N/S
Shell: _____
Chan Hd: _____
Chan Sh: _____
Boot Hd: _____
Boot Sh: _____

MAWP Shell Side N/S @ Temp. N/S
MAWP Tube Side _____ @ Temp. _____

COMMENTS: 400BBL/SINGLE WALLER**HUSKY ENERGY**
MINEHEAD COMPRESSOR STATION
LSD 03-06-049-18W5M**WATER STORAGE TANK**

TECH.: A.M.	REV. DATE:	DWG DATE: 2011/09
CAD: L.Z.	REVISION:	DRAWING: 064

HUSKY ENERGY
MINEHEAD COMPRESSOR STATION - (004)
03-06-049-18W5M - (01)

TEAM Industrial Services

Item Desc.:	WATER STORAGE TANK		Lsd:	03-06-049-18W5M
Prov. Reg.:	-----	Equip. No.:	T-320	Ser. No.: 10-797-1
SKID No.		PSV No.:		Last VE Date:

Description: BTM SHELL T-B

TML: 064-05

Nominal:	4.800	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	4.800	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	6.500	_____
Reading 02:	6.500	_____
Reading 03:	6.400	_____
Reading 04:	6.400	_____
Reading 05:	6.300	_____
Reading 06:	6.300	_____

Data Evaluation

Lowest Reading : 6.300
Average - Low 3 : 6.333
Thk.Rem. Above LFL : 1.500
Indv. Short Term Rate (mm/yr) :
Short Term Rate (mm/yr) :
LongTerm Rate (mm/yr) :

Comments:

2011/09 - INSIDE ENVIROVAULT SHELL - URETHANE FOAM - BLACK SPRAY COATING

Description: BTM SHELL S-N

TML: 064-10

Nominal:	4.800	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	4.800	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	6.600	_____
Reading 02:	6.500	_____
Reading 03:	6.200	_____
Reading 04:	6.200	_____
Reading 05:	6.200	_____
Reading 06:	6.200	_____

Data Evaluation

Lowest Reading : 6.200
Average - Low 3 : 6.200
Thk.Rem. Above LFL : 1.400
Indv. Short Term Rate (mm/yr) :
Short Term Rate (mm/yr) :
LongTerm Rate (mm/yr) :

Comments:

2011/09 - INSIDE ENVIROVAULT SHELL - URETHANE FOAM - BLACK SPRAY COATING

HUSKY ENERGY
MINEHEAD COMPRESSOR STATION - (004)
03-06-049-18W5M - (01)

TEAM Industrial Services

Item Desc.:	WATER STORAGE TANK		Lsd:	03-06-049-18W5M
Prov. Reg.:	-----	Equip. No.:	T-320	Ser. No.: 10-797-1
SKID No.		PSV No.:		Last VE Date:

Description: NORTH FLOOR S-N

TML: 064-15

Nominal:	6.400	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	6.400	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	7.200	_____
Reading 02:	7.200	_____
Reading 03:	7.100	_____
Reading 04:	7.100	_____
Reading 05:	7.100	_____
Reading 06:	7.100	_____

Data Evaluation

Lowest Reading	:	7.100
Average - Low 3	:	7.100
Thk.Rem. Above LFL	:	0.700
Indv. Short Term Rate (mm/yr)	:	
Short Term Rate (mm/yr)	:	
LongTerm Rate (mm/yr)	:	

Comments:
ASSUMED NOMINAL

Description: EAST FLOOR W-E

TML: 064-20

Nominal:	6.400	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	6.400	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	7.300	_____
Reading 02:	7.100	_____
Reading 03:	7.100	_____
Reading 04:	7.100	_____
Reading 05:	7.100	_____
Reading 06:	7.200	_____

Data Evaluation

Lowest Reading	:	7.100
Average - Low 3	:	7.100
Thk.Rem. Above LFL	:	0.700
Indv. Short Term Rate (mm/yr)	:	
Short Term Rate (mm/yr)	:	
LongTerm Rate (mm/yr)	:	

Comments:
ASSUMED NOMINAL

HUSKY ENERGY
MINEHEAD COMPRESSOR STATION - (004)
03-06-049-18W5M - (01)

TEAM Industrial Services

Item Desc.:	WATER STORAGE TANK		Lsd: 03-06-049-18W5M
Prov. Reg.:	-----	Equip. No.: T-320	Ser. No.: 10-797-1
SKID No.		PSV No.:	Last VE Date:

Description: SOUTH FLOOR N-S

TML: 064-25

Nominal:	6.400	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	6.400	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	7.200	_____
Reading 02:	7.200	_____
Reading 03:	7.300	_____
Reading 04:	7.300	_____
Reading 05:	7.400	_____
Reading 06:	7.400	_____

Data Evaluation

Lowest Reading	:	7.200
Average - Low 3	:	7.233
Thk.Rem. Above LFL	:	0.800
Indv. Short Term Rate (mm/yr)	:	
Short Term Rate (mm/yr)	:	
LongTerm Rate (mm/yr)	:	

Comments:
ASSUMED NOMINAL

Description: WEST FLOOR E-W

TML: 064-30

Nominal:	6.400	C.A. as per	C.A. L.F.L.:	0.000	Con't Service:	YES
t Min.:	--	Not Stated	L.F.L.:	6.400	Insp. Intv.	12
C.A. Calc.:	--		Mths.To L.F.L.:		Add'l Assm't:	YES

Survey Dates: 11-09-01

Reading 01:	7.400	_____
Reading 02:	7.400	_____
Reading 03:	7.300	_____
Reading 04:	7.400	_____
Reading 05:	7.300	_____
Reading 06:	7.400	_____

Data Evaluation

Lowest Reading	:	7.300
Average - Low 3	:	7.333
Thk.Rem. Above LFL	:	0.900
Indv. Short Term Rate (mm/yr)	:	
Short Term Rate (mm/yr)	:	
LongTerm Rate (mm/yr)	:	

Comments:
ASSUMED NOMINAL