

# Certificate of Inspection

**PETRO CANADA OIL & GAS**  
HANLAN ROBB  
ATTN: BRIAN PAULSON  
BOX 6480  
EDSON, AB  
T7E 1T8

PREFERRED RE-INSP. INTERVAL: 2.00 Yr.

YEAR BUILT: 2003

CRN: R4547.2

SERIAL #: B6982-20

VOLUME: 0.793 M3

HEATING SURFACE:

SURFACE AREA:

COMPANY CODE: V-801

DESCRIPTION: VERTICAL PRODUCED WATER FLASH VESSEL

LOCATION: LSD 8-13-49-18 W5M (HANLAN ROBB)

MANUFACTURER: ENERFLEX SYSTEMS LTD

50-0113-V-801


						Safety Valves	
PART	MAX. AUTHORIZED WORKING PRESSURE	MAX. TEMP	MIN. TEMP	VALVE ID	SETTING	CAPACITY	LOCATION
VESSEL	4654 KPA	93 C	-29 C	SV1			TO BE INSTALLED

## OWNER INSTRUCTIONS/REMARKS:

CONTACT THE ABSA SAFETY CODES OFFICER BEFORE PLACING THE VESSEL/BOILER IN SERVICE.

VESSEL/BOILER TO BE INSTALLED IN ACCORDANCE WITH THE SAFETY CODES ACT AND REGULATIONS.

VERIFY THAT VESSEL/BOILER IS PROTECTED BY AN ACCEPTABLE ASME CODE PRESSURE RELIEF VALVE, OF ADEQUATE CAPACITY, SET AT NO MORE THAN MAXIMUM PRESSURE AUTHORIZED AND INSTALLED IN ACCORDANCE WITH THE SAFETY CODES ACT & REGULATIONS.

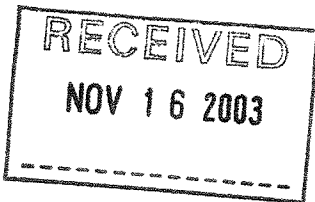

Safety Codes Officer: DENYS, METRO

Signature:

## NOTE: REQUIREMENTS OF THE SAFETY CODES ACT AND THE REGULATIONS ISSUED THEREUNDER:

The owner or person in charge shall report all accidents involving a boiler, pressure vessel or pressure piping system to the district Safety Codes Officer immediately and shall send a full report in writing to the Administrator as required by the Act. No repairs or alterations may be made unless authorized by a Safety Codes Officer.