


PENBERTHY®

Section	2000
Instal. Instr.	2950L
Issued	9/96
Replaces	6/95

Flat Glass Gages

Series L

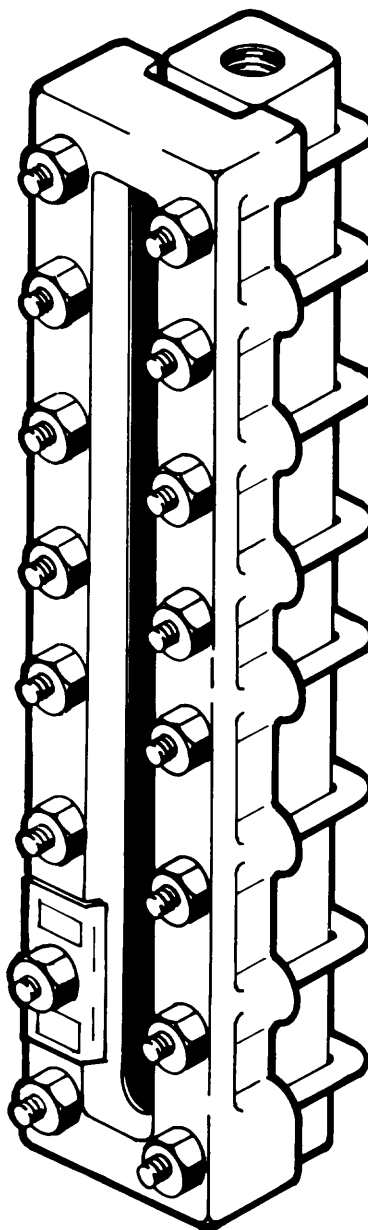

Installation/Operation/Maintenance Instructions

TABLE OF CONTENTS

Product Warranty	i
1.0 About the Manual	1
2.0 Introduction	1
2.1 System Description	1
3.0 Available Models	2
3.1 Design Ratings at Maximum and Minimum Operating Temperature	2
4.0 Inspection	3
4.1 Glass Inspection	4
4.2 User Rating Inspection	4
5.0 Installation	4
5.1 Piping Strain	5
5.2 Differential Thermal Expansion	5
5.3 Mirror Viewing	5
5.4 Nut Retorquing	5
5.5 Belleville Washers	6
6.0 Operation	6
6.1 Hydrostatic Test	7
7.0 Maintenance	7
7.1 Maintenance Procedures	8
7.2 Troubleshooting	8
8.0 Removal - Disassembly - Reassembly	9
8.1 Disassembly	9
8.2 Inspection of Glass Seating Surfaces	10
8.3 Reassembly	10
9.0 Disposal at End of Useful Life	12
10.0 Telephone Assistance	12
11.0 Exploded Parts Drawing	14

TABLES AND FIGURES	page
Table 1 Design Ratings of RL Gage	2
Table 2 Design Ratings of TL Gage	3
Table 3 Bolt Torque Values	5
Table 4 Conical Spring Height for Belleville Washers	6
Figure 1 Nut Tightening Sequence	5
Figure 2 Belleville Washer Height	6
Figure 3 Nut Loosening Sequence	9

PRODUCT WARRANTY

Penberthy Inc., warrants its products as designed and manufactured by Penberthy to be free of defects in material and workmanship for a period of one year after the date of installation or eighteen months after the date of manufacture, whichever is earliest. Penberthy will, at its option, replace or repair any products which fail during the warranty period due to defective material or workmanship.

Prior to submitting any claim for warranty service, the owner must submit proof of purchase to Penberthy and obtain written authorization to return the product. Thereafter, the product shall be returned to Penberthy in Prophetstown, Illinois, with freight prepaid.

This warranty shall not apply if the product has been disassembled, tampered with, repaired or altered outside of the Penberthy factory, or if it has been subjected to misuse, neglect or accident.

Penberthy's responsibility hereunder is limited to repairing or replacing the product at its expense. Penberthy shall not be liable for loss, damage, or expenses directly or indirectly related to the installation or use of its products, or from any other cause or for consequential damages. It is expressly understood that Penberthy is not responsible for damage or injury caused to other products, building, property or persons, by reason of the installation or use of its products.

THIS IS PENBERTHY'S SOLE WARRANTY AND IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED WHICH ARE HEREBY EXCLUDED, INCLUDING IN PARTICULAR ALL WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.

This document and the warranty contained herein may not be modified and no other warranty, expressed or implied, shall be made by or on behalf of Penberthy unless modified or made in writing and signed by the President or a Vice President of Penberthy.

1.0 About the Manual

This manual has been prepared as an aid and guide for personnel involved in installation or maintenance. All instructions must be read and understood thoroughly before attempting any installation, operation, or maintenance. Failure to follow *any* instruction could possibly result in a malfunction of the gage or glass breakage with resulting sudden release of pressure, property damage or physical injury to personnel.

SAFETY INSTRUCTIONS

Penberthy does not have any control over the manner in which its liquid level gage is handled, installed or used. Penberthy cannot and will not guarantee that a liquid level gage is suitable or compatible for the user's specific application.



WARNING



Contained fluids may be pressurized and can unexpectedly exit vessel connections due to apparatus or material failure. Safety glasses should be worn when installing a liquid level gage. Failure to do so could result in serious physical injury to personnel.

2.0 Introduction

Penberthy liquid level gages are used to allow direct visualization of liquid level in vessels. By peering through the glass, it is possible to monitor color, clarity, and level of a gas/liquid interface. Gages are available in varying lengths and configurations (end connect, side connect, multiple sections, NPT or flange connections, etc.). Visual indication can be enhanced by using reflex glass or illuminators (accessory).

2.1 System Description

Penberthy gages are comprised of six basic components. Each component may vary slightly, depending on the desired physical and mechanical properties for the gage. Use the exploded parts view in Section 11 as additional reference material.

Chamber - provides a pressure retaining metallic channel for the liquid to enter and be viewed. Slot(s) are machined into the chamber to provide direct visualization of the process fluid.

Gaskets - seal the gap and prevent leakage between the chamber and the glass. Gaskets are available in a variety of materials for compatibility with the media in the gage.

Glass - glass allows for visual observation of the process fluid in the chamber

Cushion - acts as a protective buffer between the glass and the cover. For proper sealing cushions must be as hard as or harder than the gasket material.

Cover - protects the glass assembly from external hits and provides a flat, rigid surface that is used to evenly compress the gage assembly.

Bolting - compresses the components between the covers (transparent gages) or cover and chamber (reflex gages).

Shield (optional) - used to prevent the process media from contacting the glass.

3.0 Available Models

Penberthy (Series L) low pressure liquid level gages are designed for applications other than steam/water where the physical and mechanical properties of a ductile iron cover are sufficient to meet the pressure and temperature needs of the application.

3.1 Design Ratings at Maximum and Minimum Operating Temperatures

Gasket Material	Glass Size	Model RL Reflex	
		Wetted Parts Material Steel or Stainless Steel w/B7 Bolting	
Grafoil® (standard) or Non-Asbestos		-20°F (-29°C) to 100°F (37°C)	600°F (315°C)
	1	2400 PSIG (16550 KPa)	1780 PSIG (12275 KPa)
	2	2325 PSIG (16030 KPa)	1720 PSIG (11860 KPa)
	3	2250 PSIG (15515 KPa)	1670 PSIG (11515 KPa)
	4	2175 PSIG (15000 KPa)	1600 PSIG (11030 KPa)
	5	2100 PSIG (14495 KPa)	1550 PSIG (10685 KPa)
	6	2025 PSIG (13960 KPa)	1500 PSIG (10340 KPa)
	7	1950 PSIG (13445 KPa)	1440 PSIG (9930 KPa)
	8	1875 PSIG (12930 KPa)	1390 PSIG (9585 KPa)
	9	1800 PSIG (12410 KPa)	1340 PSIG (9240 KPa)
PTFE/ Top-Chem 2000®	1 - 9	2400 PSIG (6205 KPa) at -20°F (-29°C) to 500°F (260°C) reference Application Report for gage pressure limitation at specific temperatures	
25% glass filled PTFE	1 - 9	900 PSIG (6205 KPa) at -20°F (-29°C) to 100°F (37°C) 450 PSIG (3105 KPa) at 500°F (260°C)	
NBR/Buna N®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 225 PSIG (1550 KPa) at 250°F (121°C)	
FKM/Viton®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 180 PSIG (1240 KPa) at 400°F (204°C)	
PTFE/Teflon®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 150 PSIG (2275 KPa) at 500°F (260°C)	

TABLE 1

Gasket Material	Glass Size	Model TL Transparent	
		Wetted Parts Material Steel or Stainless Steel w/B7 Bolting	
Grafoil® (standard) or Non-Asbestos		-20°F (-29°C) to 100°F (37°C)	600°F (315°C)
	1	2000 PSIG (13783 KPa)	1480 PSIG (10200 KPa)
	2	1815 PSIG (12508 KPa)	1340 PSIG (9235 KPa)
	3	1630 PSIG (11233 KPa)	1210 PSIG (8339 KPa)
	4	1440 PSIG (9924 KPa)	1060 PSIG (7305 KPa)
	5	1250 PSIG (8614 KPa)	920 PSIG (6340 KPa)
	6	1065 PSIG (7339 KPa)	790 PSIG (5444 KPa)
	7	875 PSIG (6030 KPa)	645 PSIG (4445 KPa)
	8	690 PSIG (4755 KPa)	510 PSIG (3514 KPa)
	9	500 PSIG (3446 KPa)	370 PSIG (2550 KPa)
PTFE/ Top-Chem 2000®	1 - 9	2000 PSIG (6205 KPa) at -20°F (-29°C) to 500°F (260°C) reference Application Report for gage pressure limitation at specific temperatures	
25% glass filled PTFE	1 - 9	900 PSIG (6205 KPa) at -20°F (-29°C) to 100°F (37°C) 450 PSIG (3105 KPa) at 500°F (260°C) reference Application Report for gage pressure limitation at specific temperatures	
NBR/Buna N®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 225 PSIG (1550 KPa) at 250°F (121°C)	
FKM/Viton®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 180 PSIG (1240 KPa) at 400°F (204°C)	
PTFE/Teflon®	1 - 9	300 PSIG (2070 KPa) at -20°F (-29°C) to 100°F (37°C) 150 PSIG (2275 KPa) at 500°F (260°C)	
PCTFE/(Kel-F®) Shields 0.063" (1.6 mm) thick	1 - 9	300 PSIG (2067 KPa) at -20°F (-29°C) to 100°F (37°C) 180 PSIG (1240 KPa) at 400°F (148°C)	

TABLE 2

The pressure and temperature ratings may deviate from the previous tables if the gasketing materials of construction and/or bolting are other than those specified. Higher and/or lower temperature ratings are available with different materials of construction.

To determine the maximum allowable working pressure for a specific temperature within the design limits stated in the tables, the user should refer to Penberthy dimension sheets, or when provided, the specifically stated design limits on a Penberthy product proposal.

NOTE: under no circumstances should shields be used in reflex style gages. Installation of shields in reflex style gages will keep the liquid from coming in contact with the refractive prisms, thereby prohibiting visualization of the liquid level in the gage.



DANGER



NEVER exceed these design ratings or application data. Exceeding design ratings or application data may result in mechanical failure of gage components resulting in death, serious personal injury and property damage.

4.0 Inspection

Upon receipt of a liquid level gage, check all components carefully for damage incurred in shipping. If damage is evident or suspected, do not attempt installation. Notify carrier immediately and request damage inspection.

Penberthy's standard 1 section TL gage consists of: (1) chamber, (2) gaskets, (2) borosilicate flat glass, (2) rubber bands, (2) cushions, (2) covers, (1) washer, (1) nameplate, and (6 - 14) bolting sets, depending on the size.

4.1 Glass Inspection

The self stick caution tape was applied at the factory to protect the glass during shipping, handling, and installation. Do not remove the tape from the glass until all installation procedures have been completed, except during receiving inspection to momentarily inspect glass for shipping damage. Glass that is not protected will be vulnerable to dust, grit, tools and any other objects which may scratch, chip, or break the glass.



WARNING



DO NOT use glass that is chipped or even slightly scratched. Glass surface defects weaken the glass which may result in glass breakage and fluid loss under pressure resulting in serious personal and property damage.

4.2 User Rating Inspection

The user should confirm that:

- 1) the Series L liquid level gage model and assembly number stamped on the nameplate conforms to the description on the user's purchase order,
- 2) the operating conditions described in the purchase order agree with the actual operating conditions at the installation site,
- 3) the actual operating conditions at the installation site are within the application data shown on the Penberthy Technical Data Bulletin or product proposal referred to above, and
- 4) the materials of construction of the liquid level gage are compatible with both the contained media and surrounding atmosphere in the specific application.

SAFETY INSTRUCTIONS

If the size, model, or performance data of the liquid level gage as received does not conform with any of the criteria above, do not proceed with installation. Contact an authorized Penberthy distributor for assistance. The incorrect gage can result in unacceptable performance and potential damage to the gage.

5.0 Installation

Installation should only be undertaken by qualified personnel who are familiar with equipment of this type. They should have read and understood all of the instructions in this manual. The user should refer to Penberthy dimension sheets or Penberthy product proposal to obtain dimensional information for the specific size and model liquid level gage.

Penberthy recommends that all liquid level gage installations be provided with gage valve sets equipped with ball check shut-off. Gage valve sets are designed to isolate the gages from the pressure vessel when it becomes necessary to drain or service the gages. The ball check shut-off is designed to retard leakage of the contained fluid in the event of gage glass breakage. Ball checks are available for both positive and negative vessel pressures.

The number of different types of gage and valve installations is too great to adequately detail in an installation manual. It is, therefore, the user's responsibility to assure that the knowledgeable installation personnel plan and carry out the installation in a safe manner. The following procedures are some of the installation guidelines that should be employed.

5.1 Piping Strain

The gage should be mounted and connected so that it does not support any piping weight. Piping not properly supported, independent of the gage, may subject the gage to stresses that can cause leaks or glass breakage. Support brackets are available as an accessory.

5.2 Differential Thermal Expansion


High mechanical loads may be imposed on a gage by expanding and contracting pipes due to hot or cold service. Such mechanical loads on the gage must be minimized by the use of expansion loops in the system. Failure to allow for expansion or contraction can result in leaks or glass breakage.

5.3 Mirror Viewing

For added safety, a system of indirect viewing by means of mirrors should be installed to protect personnel from the hazards of possible gage failure.

5.4 Nut Retorquing (not applicable for gages with Belleville washers) - see Section 5.5

Nut retorque is vital to the operation of a liquid level gage because gaskets take permanent set under initial bolt loading at assembly. Tightening of nuts before installation to values specified in Table 3 is necessary to insure pressure retaining capabilities of liquid level gage to specific design ratings. The user must refer to the liquid level gage model and assembly number and to the purchase order or tag to determine materials of construction.

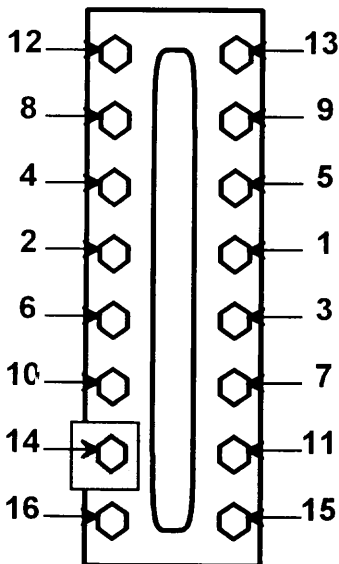

Nut Tightening Sequence
Figure 1

BOLT TORQUE VALUES

GAGE MODELS and GASKET MATERIAL	ft·lb
RL, TL w/Grafoil® (standard)	25 to 30
RL, TL w/Non-asbestos (optional)	30 to 35
Top-Chem 2000®	25 to 30
25% glass filled PTFE	20
All Models w/Teflon®, Viton® or elastomeric (optional)	10
TL with PCTFE/(Kel-F®) Shields (optional) 0.063"	10

Table 3

Using a torque wrench, tighten nuts in five **ft-lb** increments following the "Z" pattern sequence in Figure 1, until the torque values shown in Table 3 above for the specific liquid level gage are reached. For multiple section gages, torque the center section(s) and progressively work toward the ends of the gage.

If bolting, gasketing or glass on any or repaired section of a multi-section gage is disturbed, all sections must be checked for integrity and retorqued as necessary.



WARNING




Failure to comply with the proper torquing sequence or force/height value can lead to leakage, gasket blow-out or glass breakage resulting in gage failure, serious injury and/or property damage.

NOTE: Depending on gage size there may be less bolting than shown in Figure 1. Start at the center and follow "Z" pattern outward to the limit of bolting on a specific gage.

5.5 Belleville Washers

Belleville washers are used to reduce or eliminate the need to retorque nuts. This is especially important for gages subject to pressure and/or thermal cycling and also in offshore applications where use of wrenches often cracks or chips the protective coat. The conical washers allow for material expansion and contraction while maintaining axial bolt loading and, therefore, compression on the gasket.

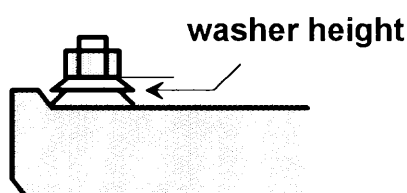

Belleville Washer Height
Figure 2

**CONICAL SPRING HEIGHT
FOR BELLEVILLE WASHERS**

GAGE MODELS	No of Washers per nut	Spring Height (top of cover to bottom of nut) inch (mm)
RL	3	0.200 (5.1)
TL	2	0.136 (3.5)

Table 4

The effective range of a Belleville washer is measured in height (or compression distance) of the washer **NOT TORQUE**. Refer to Figure 2 and Table 4 for proper compression height. Do not tighten nuts until the washers are flat. Belleville washers cannot absorb expansion when flat.

If bolting, gasketing or glass on any section of a multi-section gage is disturbed, all sections must be checked for integrity and stack height, if necessary.

6.0 Operation

Before initializing liquid level gage operation, check that all installation procedures have been completed. Use only qualified, experienced personnel who are familiar with liquid level gage equipment and thoroughly understand the implications of the tables and all the instructions. Check to determine that all connections are pressure tight. Assure that nuts have been retorqued to their

proper values as specified in Table 3. Remove self stick caution tape from the glass and inspect to be sure that glass is clean and free of any damage such as cracks, scratches, pits, and chips.

6.1 Hydrostatic Test



DANGER



Liquid level gage installations should be brought into service slowly to avoid excessive shock or stress on the glass. Rapid pressurization or sudden changes in temperature may cause glass breakage. To avoid excessive thermal shock or mechanical stress on glass, the connecting valves should be opened slightly, and the gage temperature and pressure allowed to slowly equalize. If the valves are equipped with ball checks, the valves must be opened all the way after the pressure and temperature have equalized to permit operation of the automatic ball checks in the event of failure. Failure to follow the recommended operating procedures can result in death, severe personal injury and/or property damage.

Take all precautions necessary to handle the possibility of leakage during the test. Hydrostatically pressure test all installations to at least 100 PSIG but less than design pressure and correct any leakage before proceeding.

7.0 Maintenance



WARNING



Use only qualified, experienced personnel who are familiar with liquid level gage equipment and thoroughly understand the implications of the tables and all the instructions. DO NOT proceed with any maintenance unless the liquid level gage has been relieved of all pressure or vacuum, has been allowed to reach ambient temperature and has been drained or purged of all fluids. Failure to do so can cause serious personal injury and property damage.

The rate at which components degrade is dependent upon a variety of conditions. Pressure, temperature and process media all influence the rate at which gage components deteriorate. Higher temperatures can accelerate the deterioration of gaskets, cushions, glass, and metals. Acids and similar chemicals can break down the integrity of almost any material. Concentration of chemicals can accelerate the corrosion rate. Penberthy cannot create a blanket maintenance schedule for every application.

The end user is the most familiar with the process media and conditions and must be responsible for creating a maintenance schedule. The user must create maintenance schedules, safety manuals, and inspection details for each liquid level gage. Realistic maintenance schedules can only be determined with full knowledge of the services and application situations involved. These will be based upon the user's own operating experience with their specific application.

On all installations the following items should be regularly evaluated by the user for purposes of maintenance:

- 1) glass, for cleanliness and signs of damage or wear,
- 2) shields, if used, for signs of clouding, wear or deterioration,
- 3) gage, for signs of leakage around gaskets or at connections and
- 4) gage, for signs of internal or external corrosion.

If bolting, gasketing or glass on any section of a multi-section gage is disturbed, all sections must be checked for integrity and retorqued or repaired as necessary.

7.1 Maintenance Procedures

GLASS should be given regular and careful attention. Keep glass clean using a commercial glass cleaner and a soft cloth. Inspect the surface of the glass for any clouding, etching or scratching or physical damage such as bruises, checks or corrosion. Glass that is damaged is weakened and may break under pressure. Shining a light at approximately a 45° angle will aid in detecting some of these conditions. Typical damaged areas will glisten more brightly than the surrounding glass because the light is reflected.

Detection of any damage, problem areas or surface wear is sufficient evidence to take the liquid level gage out of service. DO NOT proceed with operation of the liquid level gage until the glass has been replaced with a glass replacement kit following the disassembly - reassembly instructions in Section 8.

SHIELDS showing any signs of clouding, wear, or deterioration are an indication that the gage glass has been exposed, or could soon be exposed to the contained fluid. Immediately take liquid level gage out of service. DO NOT proceed with operation of the liquid level gage until shields and glass have been replaced by following the disassembly-reassembly instructions in Section 8.

GASKET LEAKS must be repaired immediately. DO NOT proceed with operation of a liquid level gage until gaskets have been replaced by following Section 8 disassembly-reassembly instructions.

CONNECTION LEAKS at a flanged or threaded connection should be corrected by tightening the bolting at the connection or by taking the liquid level gage out of service and wrapping the connection threads with Teflon® tape on all male pipe threads.

CORROSION may occur if the user has selected an improper material for the liquid level gage application. It is the responsibility of the user to choose a material of construction compatible with both the contained fluid and the surrounding environment. If internal or external corrosion is present, an investigation must immediately be performed by the user. It may be necessary to contact an authorized Penberthy distributor to better determine the origin of the corrosion.

7.2 Troubleshooting

Problem:	glass becomes prematurely etched or clouded in service
Cause:	fluid being handled is not compatible with the glass or shields

- Solution: replace the glass and install shields which will not be affected by contained fluid
- Problem: glass continually breaks in service despite careful attention to maintenance procedures
- Cause: thermal shock, hydraulic shock, mechanical loads, exceeding design ratings or a combination of these
- Solution: check entire system to determine possible sources of loads. Check application to determine actual operating conditions and contact an authorized Penberthy distributor on how to proceed.

8.0 Removal - Disassembly - Reassembly




WARNING



Use only qualified, experienced personnel who are familiar with liquid level gage equipment and thoroughly understand the implications of the tables and all the instructions. **DO NOT** proceed with any maintenance unless the liquid level gage has been relieved of all pressure or vacuum, has been allowed to reach ambient temperature, and has been drained or purged of all fluids. Failure to do so can cause serious personal injury and property damage.

8.1 Disassembly

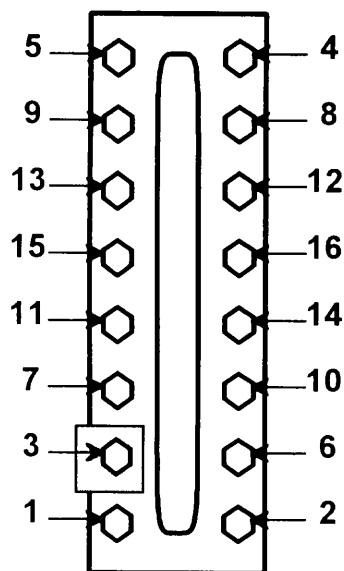

Nut Loosening Sequence
Figure 3

Secure workbench longer than the liquid level gage, and sufficiently wide to lay out parts as they are removed.

- 1) Lay gage on bench so nut side of fastener is up.
- 2) Hold gage firmly, and loosen nuts starting at both ends of each section and then proceeding from both ends to the center of each section as shown in Figure 3.
- 3) Nut Loosening Sequence
 - remove nuts, washer, belleville washers (if any) and nameplate
 - tap covers with rubber hammer as needed to loosen and remove
 - for belleville washer assemblies: to remove covers, studs may need to be removed by laying the assembly on its side and knocking the stud/U-bolts through the cover with a hammer and punch
 - remove cushions, glass, shields (if any), and gaskets
 - tap liquid chamber or remaining covers as necessary with rubber hammer to break loose, and remove remaining components
 - remove, destroy, and dispose of all glass, cushions, gaskets, and shields. Under no circumstances should

these components be re-used or installed on a gage

NOTE: If size of gage is smaller than shown, follow "Z" sequence from the ends until all bolting is loosened.



WARNING



After assembly and proper torquing, cushions, gaskets and shields are permanently deformed by compression and if re-used, may cause leaks and high stress points resulting in glass breakage. Glass may contain hidden damage and internal stresses caused by previous usage. If re-used, the glass may break under pressure causing personal and property damage.

8.2 Inspection of Glass Seating Surfaces

Clean the glass seating surfaces on the liquid chamber and cover with a soft metal scraper (preferably brass) to remove all burrs, rust, and remnants of the previous gaskets and cushions. Exercise extreme care to avoid gouging or scarring gasket and cushion seating surfaces.

Use a known flat piece of metal the same approximate length as the glass or a new piece of glass and a thickness gage to check flatness of each glass seating surface on liquid chamber and under cover. Surface must be flat within 0.002 inch (0.051 mm). If any one surface is found to be beyond a tolerance of 0.002 inch (0.051 mm), the entire gage must be disposed of and replaced. Gasket seating surface must have a final surface finish of 450 to 500 AARH.



WARNING



Flatness of glass seating surfaces outside 0.002 inch tolerance specified is an indication of the gage having been overstressed through repeated exposure to mechanical, thermal, or hydraulic shock during its previous service. Operation of a liquid level gage which has been overstressed will result in abnormal stresses on the glass which may cause glass to break. If surface finish is not in the 450-500 AARH range, gasket may extrude under pressure with resulting sudden release of pressure, leakage of contained fluid, serious personal injury, or property damage.

Glass seating surfaces should NOT be machined to achieve seating tolerance. The chamber and cover are designed for a critical thickness to achieve the pressure/temperature ratings. Machining glass seating surfaces may result in non-compliance to the necessary critical thickness due to material removal.

8.3 Reassembly

If all glass seating surfaces are found to be within the 0.002 inch (0.051mm) tolerance described in the previous section, proceed to obtain new glass, gaskets, cushions and shields (if used) and proceed to reassemble as follows (refer to exploded parts view in Section 11 if needed):

- 1) clean threads on bolt and nuts to remove all paint, rust, and scale. Apply a light coat of oil to the threads.

- 2) for transparent gages, insert bolts through half the cover and lay out covers along bench, side by side, with the liquid chambers. Use chambers to space covers and line them up with vision slots.
- 3) for reflex style and belleville reflex style gages, lay out covers along bench, side by side, with liquid chambers. Use chambers to space covers and line them up with vision slots.
- 4) for transparent belleville style gages, thread nuts on stud, place two belleville washers under nut with pointed end toward the nut (see Figure 2), insert stud through each cover and lay out covers along bench, side by side, with liquid chambers. Use chambers to space covers and line them up with vision slots.
- 5) install one cushion inside each cover.



WARNING



Separate installation instructions are supplied with replacement glass. All instructions supplied with the glass must be followed as there are precautions to be taken when handling gage glass. Among the precautions is avoidance of bumping or sliding glass against any surface and inspection of individual pieces. Failure to follow any of the replacement gage glass installation instructions could result in glass breakage with resulting sudden release of pressure, personal or property damage.

- 6) install rubber band around each piece of glass, then place glass centered inside each cover.
- 7) install shields, if used, and gasket on glass being careful to keep components centered.
- 8) place liquid chamber on the gaskets making sure all components are aligned with vision slot.
- 9) for reflex gage, install U-bolts in place by tapping as needed with rubber hammer, being careful not to lose alignment with vision slot.
- 10) for reflex gage, quickly turn over assembly onto back side of U-bolts. Assemble nameplate, washer, and nuts to U-bolts. Tighten nuts with fingers. Using a torque wrench, tighten nuts in five ft-lb increments, following the sequence in Figure 1 until the torque values shown in Table 3 are reached.

NOTE: Depending on gage size there may be less bolting than shown in Figure 1. Start at the center and follow "Z" pattern outward to the limit of bolting on a specific gage.

- 11) for transparent gage, install gaskets in place, and shields if used.
- 12) install rubber band around each piece of glass, then place glass centered inside each cover. **NOTE WARNING ABOVE**
- 13) install one cushion on each piece of glass
- 14) install covers in place being careful to maintain components alignment inside.
- 15) install nameplate, washer, and nuts to studs. Tighten nuts with fingers. Using a torque wrench, tighten nuts in five ft-lb increments, following the sequence in Figure 1 until the torque values shown in Table 3 are reached.
- 15A) for transparent belleville style gages: install nameplate and two belleville washers under each nut with pointed end toward the nut (see Figure 2). Finger tighten nuts.

NOTE: the following procedure is to be done on only one side of the gage.

15B) for reflex belleville style gages: install nameplate and three belleville washers under each nut with pointed end toward the nut (see Figure 2). Finger tighten nuts.

16A) Using a torque wrench, tighten nuts in five **ft-lb** increments, following the sequence in Figure 1. Once 20 **ft-lb** is reached, begin measuring stack height. Tighten nuts in five **ft-lb** increments until stack spring height is within 0.008" (0.2 mm) of proper height. Individually tighten each nut until stack height is achieved. (see Table 5) To estimate washer height, add the thickness of the nut to the compressed height requirement and use this value to compare to the measurement from the top of the nut to the face of the cover.

Refer to Section 5 for installation and Section 6 for operation of liquid level gage when returning to service.

9.0 Disposal at End of Useful Life

Penberthy gages are used in a variety of fluid applications. By following the appropriate governmental and industry regulations, the user must determine the extent of preparation and treatment the gage must incur before its disposal. A Material Safety Data Sheet (MSDS) may be required before disposal services accept certain components.

Metals, glass, and polymers should be recycled whenever possible. Refer to order and Penberthy's Material Specification sheets for materials of construction.

10.0 Telephone Assistance

If you are having difficulty with your liquid level gage, notify your local Penberthy distributor. You may also contact the factory direct at (815) 537-2311 and ask for an applications engineer. So that we may assist you more effectively, please have as much of the following information as possible when you call:

- Model #
- Name of the company from whom you purchased your liquid level gage
- Invoice # and date
- Process fluid
- Operating pressures
- Operating temperatures
- A brief description of the problem
- Troubleshooting procedures that failed

If attempts to solve your problem fail, you may be requested to return your liquid level gage to the factory for intensive testing. You must obtain a Return Authorization (R.A.) number from Penberthy prior to returning anything. Failure to do so will result in the unit being returned to you, without being tested, freight collect. To obtain a R.A. number, the following information (in addition to that above) is needed:

- Reason for return
- Person to contact at your company
- "Ship To" address


We recommend that you return the entire unit for testing. There is a minimum charge of \$75.00 for evaluation of non-warranty units. You will be contacted before any repairs are initiated should the

cost exceed the minimum charge. If you return a unit that is covered by the warranty, but is not defective, the minimum charge will apply.

Grafoil® is a registered trademark of Union Carbide Corporation
Neoprene®, Viton®, and Teflon® are registered trademarks of E. I. du Pont de Nemours and Company
Top Chem 2000® is a registered trademark of Klinger
Kel-F® is a registered trademark of 3M

11.0 Exploded Parts Drawing

Transparent

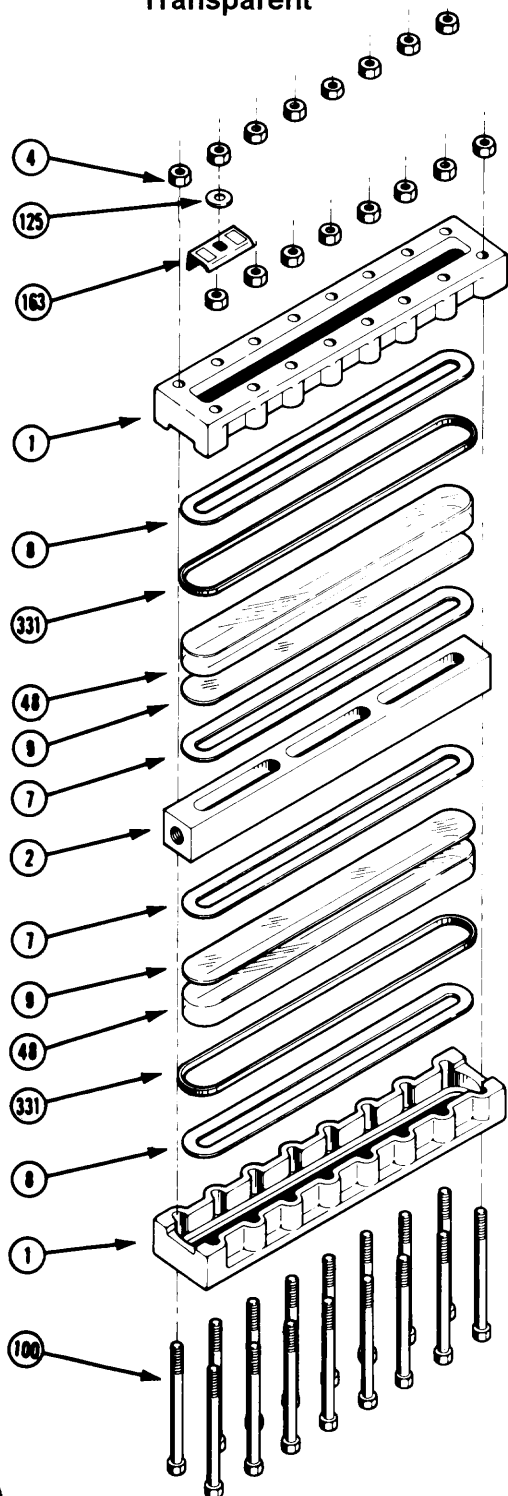


- 1 - Cover
- 2 - Chamber
- 4 - Nut
- 48 - Glass
- 7 - Gasket
- 8 - Cushion
- 9 - Shield
- 100 - Bolt/U-bolt
- 125 - Washer
- 163 - Nameplate
- 331 - Band

Recommended Spare Parts

REF #	ITEM	QTY
100	Bolt/U-bolt	2/1 per sect.
4	Nut	2 per sect.
48	Glass	1
7	Gasket	2
8	Cushion	2
9	Shield (if used)	2

Reflex

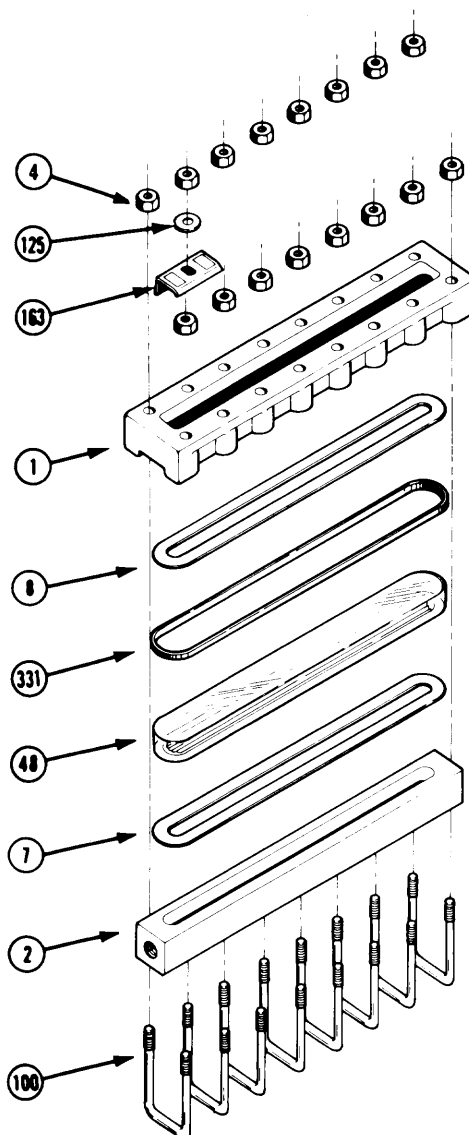

NOTE: size 9 shown - actual gage may be shorter and require fewer bolting components

PENBERTHY

≈ DECLARATION of CONFORMITY ≈

In conformance with ISO/IEC Guide 22 - 96
LLG.DC r C

Manufacturer's Name: Penberthy, Incorporated
Manufacturer's Address: 320 Locust Street
Prophetstown, IL 61277-1147 U.S.A.
Product:
Type of Equipment: Pressure Vessel - Liquid Level Gauge Glass
Equipment Class: Industrial Instrumentation - Hazardous Area
Model Designations: RL, TL, RM, TM, RH, TH, RMW, TMW, RLC, TLC

The product described above is in conformity with:

92/59/EEC	General product safety	1992
87/404/EEC	Simple pressure vessel	1987
89/392/EEC	Machinery	1989
EN 10213-1:4	Technical delivery conditions for steel castings	1996
ISO 7-1	Pipe threads where pressure-tight joints are made	1996
BS 10	Flanges and bolting for pipes, valves and fittings	1962
BS 21	Pipe threads for tubes and fittings where pressure-tight	1985
BS 759	Valves, gauges and other safety fittings for application	1984
BS 970 Part 1	Wrought steels for mechanical and allied engineering	1996
BS 970 Part 3	Wrought steel for mechanical and allied engineering	1991
BS 1501 Part 3	Steels for presure purposes	1990
BS 1502	Steels for fired and unfired pressure vessels	1982
BS 1506	Carbon, low alloy and stainless steel bars and billets	1990
BS 1560	Circular flanges for pipes, valves and fittings	1989
BS 1640 Part 1	Steel butt-welding pipe fittings	1962
BS 1640 Part 2	Steel butt-welding pipe fittings	1962
BS 1965	Butt-welding pipe fittings	1963
BS 3076	Nickel and nickel alloys: bar	1989
BS 3463	Observation and gauge glasses for pressure vessels	1975
BS 3602 Part 1	Steel pipes and tubes for pressure purposes	1987
BS 3605	Austenitic stainless steel pipes and tubes	1991
BS 3643	ISO metric screw threads	1981
BS 3799	Steel pipe fittings, screwed and socket-welding	1974
BS 4504	Circular flanges for pipes, valves and fittings	1989
ASME B&PV Code, Section VIII	Rules for construction of pressure vessels	1995
ANSI/ASME B1.1	Unified screw inch threads un and unr thread form	1982
ANSI/ASME B1.20.1	Pipe threads, general purpose (inch)	1983
ANSI/ASME B16.5	Pipe flanges and flanged fittings	1988
ANSI/ASME B18.2.1	Square and hex nuts and screw inch series	1981
ANSI/ASME B18.2.2	Square and hex: nuts	1972
ANSI/ASME B31.3	Process piping	1996

Date: 30 December 1996
Prophetstown, IL U.S.A.

Signature: 
Name: David J. Williams, C.Q.E.
Position: Quality Assurance Manager

Technical Construction File is available at stated address. Signatory is contact person.

Notes

PENBERTHY

320 Locust St., Prophetstown, Illinois 61277

Telephone: 815/537-2311

Fax: 815/537-5764

Printed in U.S.A.

Part No. 18R65-009

