


PRE ~~Z~~ ERVER™

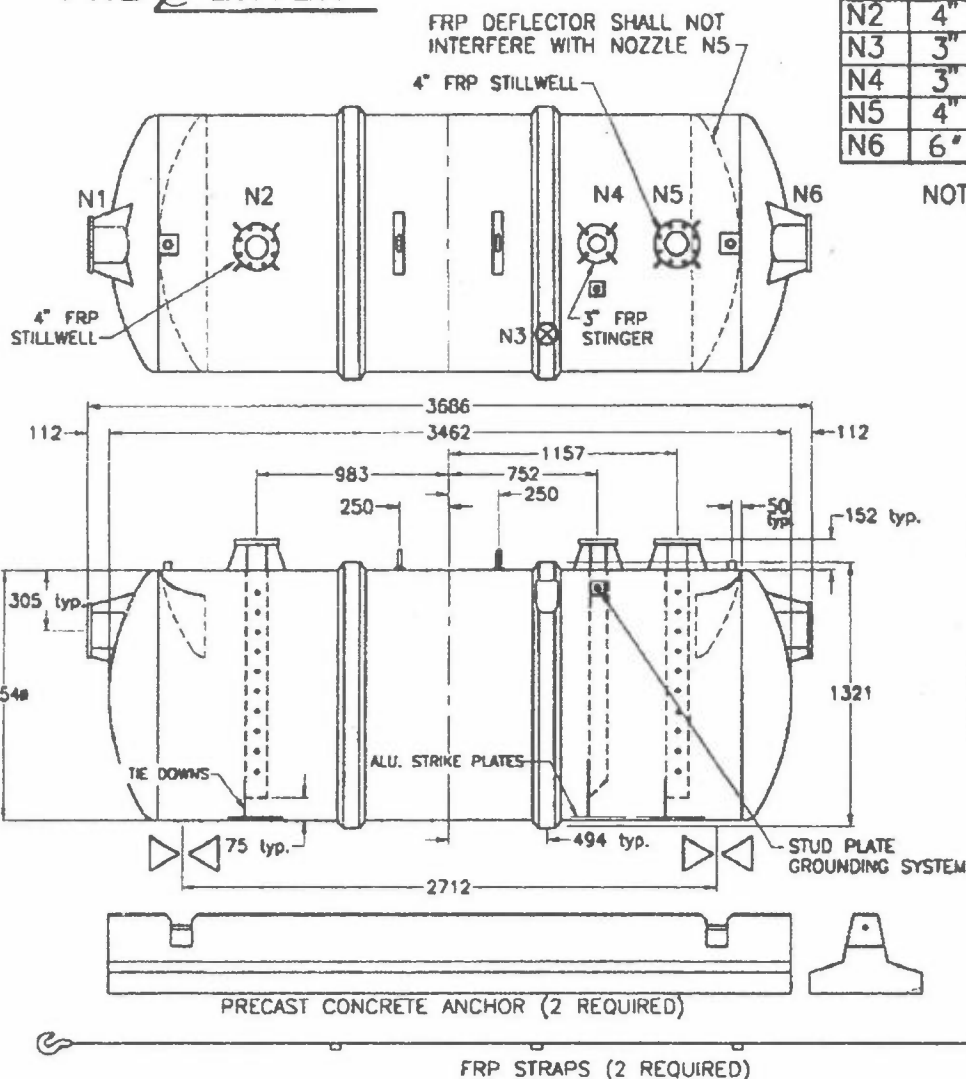


NOZZLE SCHEDULE

POS	SIZE	DESCRIPTION	SERVICE
N1	6"	150# FRP FF FLANGE	OUTLET
N2	4"	150# FRP FF FLG W/FRP STILLWELL	LEVEL INDICATOR
N3	3"	NPT FRP CPLG W/FLEXIBLE DIPSTICK	MONITOR
N4	3"	150# FRP FF FLG W/FRP STINGER	PUMPOUT
N5	4"	150# FRP FF FLG W/FRP STILLWELL	LEVEL SWITCH
N6	6"	150# FRP FF FLANGE	INLET

- NOTE:
- WALL THICKNESS SHALL BE 0.500" (NOMINAL)
 - REFER TO DWG M/E/1584.0 FOR STUD PLATE GROUNDING SYSTEM
 - TANK IS ALL FUELS RESIN
 - DESIGN PRESSURE = 14.9 PSI
 - HYDROSTATIC TEST TO 50 PSI
 - ALL FLANGES ARE 150# ANSI FLANGE DRILLING PATTERN
 - ALL FRP OUTLETS TO BE GUSSETED
 - ALUMINUM NAME PLATE REQUIRED FOR EACH TANK

STRAPPING DIM.
520 mm



MONITOR RISER
(SCH80 3" PVC)

1" NPT ANNULUS VENT

LIFTING LUG

HOLD DOWN STRAP LOCATION

AUTHORIZED TO PROCEED WITH CONSTRUCTION

BY Steve C. Wong
DATE Oct. 29/96

SCALE: SHEET: DRN: DATE:
N.T.S. CHEVB LJM OCT 25/96

DRAWING NO.:
M/E/2767.1

DATE: OCT 29/96 REVISION: MODIFIED WALL THICKNESS FROM 0.750" TO 0.500" (NOMINAL)

TITLE: P40DW - 25 bbl - FKO
CHEVRON CANADA RESOURCES
SYLVAN LAKE



PHONE: (403) 466-3006
FAX: (403) 466-6126

ZCL FIBERGLASS LTD.
EDMONTON, ALBERTA