


BMS (Profire 2100)

JUNCTION BOX

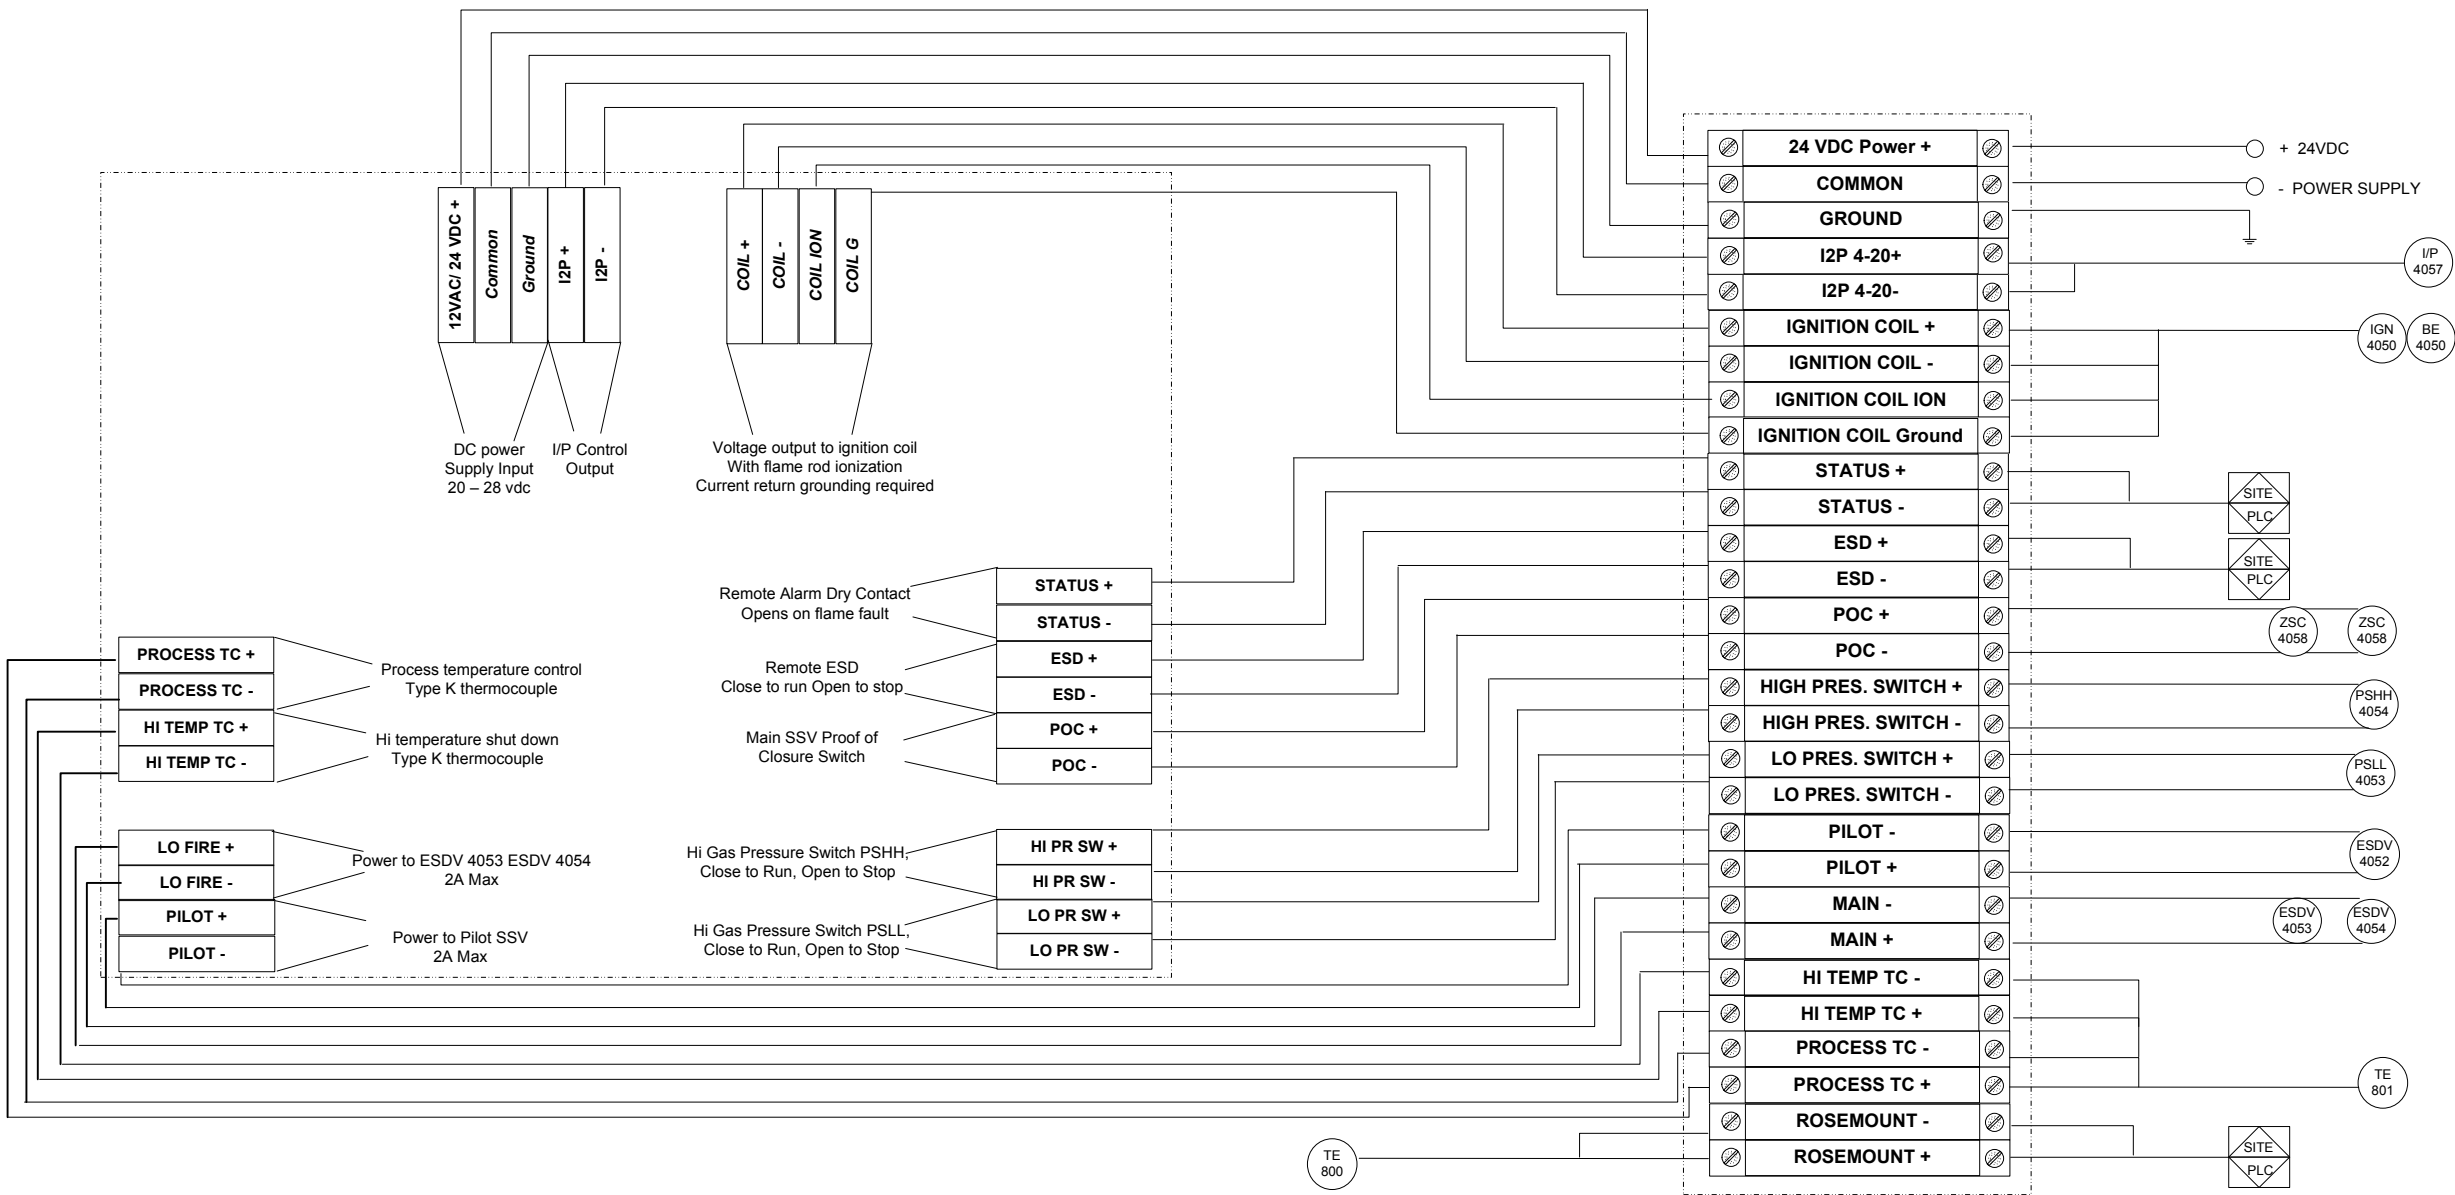

POWER CONSUMPTION

Profire 2100	2.8 watts
ESDV 4052	4 watts
ESDV 4053	1 watt
ESDV 4054	1 watt
TIT 800	Loop powered by PLC

Rated for Class 1 Div 2 Area

0	ISSUED FOR INFORMATION	2013/06/12	SNA



Prepared By: SNA

Date: 2013/06/12

QUESTOR TECHNOLOGY INCORPORATED

Client: Excelsior Engineering – Husky Energy
Location: McMullen 04-35-078-25-W4M

Q250 Incinerator Junction Box Wiring Diagram

Job No.: 20121112-133 Dwg: 12133-D-E-101 Scale: NTS Sheet: 1 Rev.: A